

aurecon

Little River Fire Station
Quantitative Engineering
Evaluation

Reference: 228601

Prepared for:
Christchurch City Council

Functional Location ID: PRO 3663 B001

Revision: 2

Address: 40 Western Valley Road, Little River

Date: 10 April 2014

Document Control Record

Document prepared by:

Aurecon New Zealand Limited
 Level 2, 518 Colombo Street
 Christchurch Central
 PO Box 1061
 Christchurch 8140
 New Zealand

T +64 3 375 0761
F +64 3 379 6955
E christchurch@aurecongroup.com
W aurecongroup.com

A person using Aurecon documents or data accepts the risk of:

- a) Using the documents or data in electronic form without requesting and checking them for accuracy against the original hard copy version.
- b) Using the documents or data for any purpose not agreed to in writing by Aurecon.

Document control				aurecon		
Report Title		Quantitative Engineering Evaluation				
Functional Location ID		PRO 3663 B001	Project Number		228601	
File Path		P:\ 228601 - Little River Fire Station.docx				
Client		Christchurch City Council	Client Contact		Michael Sheffield	
Rev	Date	Revision Details/Status	Prepared	Author	Verifier	Approver
1	15 January 2014	Draft	R.Tan	H.Burnett	M.Bellamy	M.Bellamy
2	10 April 2014	Final	R.Tan	H.Burnett	M.Bellamy	M.Bellamy
Current Revision		2				

Approval			
Author Signature		Approver Signature	
Name	Hugh Burnett	Name	Mark Bellamy
Title	Structural Engineer	Title	Chartered Professional Engineer



Contents

Executive Summary	1
1 Introduction	2
1.1 General	2
2 Description of the Building	2
2.1 Building Age and Configuration	2
2.2 Building Structural Systems Vertical and Horizontal	2
2.3 Reference Building Type	2
2.4 Building Foundation System and Soil Conditions	3
2.5 Available Structural Documentation and Inspection Priorities	3
2.6 Available Survey Information	3
3 Structural Investigation	4
3.1 Summary of Building Damage	4
3.2 Record of Intrusive Investigation	4
3.3 Damage Discussion	4
4 Building Review Summary	4
4.1 Building Review Statement	4
4.2 Critical Structural Weaknesses	4
5 Building Strength (Refer to Appendix C for background information)	5
5.1 General	5
5.2 Initial %NBS Assessment	5
5.3 Results Discussion	5
6 Conclusions and Recommendations	6
7 Explanatory Statement	6

Appendices

Appendix A Site Map, Photos and Levels Survey Results

Appendix B References

Appendix C Strength Assessment Explanation



Appendix D Background and Legal Framework

Appendix E Standard Reporting Spreadsheet

Appendix F Strengthening Scheme

Executive Summary

This is a summary of the Quantitative Engineering Evaluation for the Little River Fire Station building and is based on the Detailed Engineering Evaluation Procedure document issued by the Engineering Advisory Group on 19 July 2011, visual inspections, available structural documentation and summary calculations as appropriate.

Building Details	Name	Little River Fire Station		
Building Location ID	PRO 3663 B001	Multiple Building Site	Y	
Building Address	40 Western Valley Road, Little River	No. of residential units	0	
Soil Technical Category	NA	Importance Level	4	Approximate Year Built 1978
Foot Print (m²)	130	Stories above ground	1	Stories below ground 0
Type of Construction	Lightweight roof, steel portal frames, light timber framed walls, slab on grade floor.			
Quantitative L5 DEE Report Results Summary				
Building Occupied	Y	The Little River Fire Station is currently in use.		
Suitable for Continued Occupancy	Y	The Little River Fire Station is suitable for continued occupation.		
Key Damage Summary	Y	Refer to summary of building damage Section 3.1 report body.		
Critical Structural Weaknesses (CSW)	N	No critical structural weaknesses were identified.		
Levels Survey Results	Y	Variations in floor levels were within the DBH's Guidelines, with falls of less than 1:200 or 0.5%.		
Building %NBS	38%	Based on detailed calculations.		
Approval				
Author Signature		Approver Signature		
Name	Hugh Burnett	Name	Mark Bellamy	
Title	Structural Engineer	Title	Chartered Professional Engineer	



1 Introduction

1.1 General

Aurecon engineers visited the Little River Fire Station to carry out a qualitative building damage assessment on behalf of Christchurch City Council. Detailed visual inspections were carried out to assess the damage caused by the earthquakes on 4 September 2010, 22 February 2011, 13 June 2011, 23 December 2011 and related aftershocks.

The scope of work included:

- Assessment of the nature and extent of the building damage.
- Visual assessment of the building strength particularly with respect to safety of occupants if the building is currently occupied.
- Assessment of requirements for detailed engineering evaluation including geotechnical investigation, level survey and any areas where linings and floor coverings need removal to expose structural damage.

This report outlines the results of our Qualitative Assessment of damage to the Little River Fire Station and is based on the Detailed Engineering Evaluation Procedure document issued by the Structural Advisory Group on 19 July 2011, visual inspections, available structural documentation and summary calculations as appropriate.

2 Description of the Building

2.1 Building Age and Configuration

Built circa 1978 the Little River Fire Station is a single storey building consisting of two rooms used to house fire trucks and equipment. The building is attached to the Little River community facilities. It has a lightweight profiled steel roof, steel portal frames, a combination of weatherboard and hardies sheet external cladding, timber framed walls, and a concrete slab on grade foundation. The internal linings consist of particle board on the walls and acoustic boards on the ceiling. The approximate floor area of the building is 130 square metres. It is an importance level 4 structure; in accordance with NZS 1170 Part 0:2002 due to the critical importance of the building and contents in an emergency.

2.2 Building Structural Systems Vertical and Horizontal

The Little River Fire Station is a simple structure. Its lightweight steel roof is supported on steel portal frames that transfer loads to the foundations. The timber framed walls are supported on the concrete slab on grade floor. Lateral loads are resisted by the steel portal frames in the transverse (north-south) direction and by the lined timber framed walls in the longitudinal (east-west) direction.

2.3 Reference Building Type

The Little River Fire Station is a basic portal framed structure typical of its age and style. The bolted and welded moment steel frames building type referenced in the “Guidance on Detailed Engineering Evaluations of Earthquake Affected Non-Residential Buildings in Canterbury” document issued by the Engineering Advisory Group applies to this building. The Little River Fire Station has performed well with none of the known issues associated with this type of construction occurring.



2.4 Building Foundation System and Soil Conditions

The Little River Fire Station has a concrete slab on grade foundation. The land and surrounds of Little River Fire Station are zoned Port Hills and Banks Peninsula and are unlikely to be susceptible to liquefaction or differential settlement. Additionally there are no signs in the vicinity of Little River Fire Station of liquefaction bulges or boils and subsidence.

2.5 Available Structural Documentation and Inspection Priorities

No structural drawings were available for the Little River Fire Station however we were able to obtain a partial set of architectural drawings. Inspection priorities related to a review of potential damage to the portal frames, foundations and walls.

2.6 Available Survey Information

A floor level survey was undertaken to establish the level of unevenness across the floors. The results of the survey are presented on the attached sketch in Appendix A. All of the levels were taken on top of the existing floor coverings which may have introduced some margin of error.

The Department of Building and Housing (DBH) published the “Revised Guidance on Repairing and Rebuilding Houses Affected by the Canterbury Earthquake Sequence” in November 2011, which recommends some form of re-levelling or rebuilding of the floor:

1. If the slope is greater than 0.5% for any two points more than 2m apart, or
2. If the variation in level over the floor plan is greater than 50mm, or
3. If there is significant cracking of the floor.

It is important to note that these figures are recommendations and are only intended to be applied to residential buildings. However, they provide useful guidance in determining acceptable floor level variations.

The floor levels for the Little River Fire Station were found to be within the recommended tolerances once the various floor coverings are taken into account.



3 Structural Investigation

3.1 Summary of Building Damage

The Little River Fire Station was in use at the time the damage assessment was carried out.

The Little River Fire Station has performed well and no damage from the recent earthquakes was noted.

3.2 Record of Intrusive Investigation

Intrusive investigations were carried out to determine the base fixing details of the steel portal frames and the detailing at the knee joints of the portal frames. The base fixings of the portal frames were found to consist of a base plate with two bolts cast approximately 100mm below finished floor level and a deformed bar approximately 15mm diameter bent in a hairpin shape placed through the web of the UB and cast into the slab. The knee joints were found to have a single stiffener each side of the web with a thickness similar to that of the UB flanges.

3.3 Damage Discussion

There was no observed damage to the Little River Fire Station as a result of seismic actions. This is not surprising as buildings of this nature are flexible and have high inherent ductility. Additionally being lightweight the building generates a relatively low seismic demand.

4 Building Review Summary

4.1 Building Review Statement

Due to the generic nature of the building a significant amount of information was able to be inferred from an external and internal inspection.

4.2 Critical Structural Weaknesses

No specific critical structural weaknesses were identified as part of the building qualitative assessment.

5 Building Strength (Refer to Appendix C for background information)

5.1 General

The Little River Fire Station is, as discussed above, a typical example of a steel portal frame building. It is of a type of building that, due to its light weight, flexibility and natural ductility, has typically performed well. The Little River Fire Station is not an exception to this. It has performed well and no damage to the building related to the recent earthquakes was noted. Although the building is directly connected to the Little River Community Centre this has not had an adverse effect on the performance of the building and the potential for damage due to the interaction of the two buildings is considered to be low.

5.2 Initial %NBS Assessment

The Little River Fire Station has been assessed with quantitative DEE calculations. The strength and demand of the lateral load resisting elements in each direction has been calculated to obtain the critical %NBS case.

Selected assessment seismic parameters are tabulated in the Table 1 below.

Table 1: Parameters used in the Seismic Assessment

Seismic Parameter	Quantity	Comment/Reference
Site Soil Class	D	NZS 1170.5:2004, Clause 3.1.3, Deep or Soft Soil
Site Hazard Factor, Z	0.30	DBH Info Sheet on Seismicity Changes (Effective 19 May 2011)
Return period Factor, R_u	1.8	NZS 1170.5:2004, Table 3.5 (Importance Level 4)
Ductility Factor in Transverse Direction, μ	3.00	Steel portal frames
Ductility Factor in Longitudinal Direction, μ	3.00	Lined timber framed walls

The seismic capacity for the Little River Fire Station has been calculated using the DEE procedure. The capacity of the building was found to be 38% NBS. The results find the building has a capacity of 100% of NBS in the longitudinal direction and 38% of NBS in the transverse direction.

5.3 Results Discussion

The Little River Fire Station achieves 38% NBS based on the transverse direction result from the quantitative strength assessment. This places the building in the moderate risk category for building earthquake capacity. The limiting factor in the transverse direction is the strength of the portal frame.



6 Conclusions and Recommendations

Because the building has achieved an earthquake prone rating, it is recommended that the building be strengthened to 100% of NBS, the calculations and strengthening scheme related to bringing the building up to 100% of NBS are attached in Appendix F.

The land below the Little River Fire Station is zoned as Port Hills and Banks Peninsula and as such is not expected to be prone to liquefaction and settlement. Additionally there is no local evidence of settlement and liquefaction in the surrounding land and **the levels survey carried out showed that the floor levels were within allowable tolerances.**

As there is no clear evidence of any liquefaction or ground movement in the vicinity of the Little River Fire Station **a geotechnical investigation is currently not considered necessary.**

The building is currently occupied and in our opinion the Little River Fire Station **is suitable for continued occupation.**

7 Explanatory Statement

The inspections of the building discussed in this report have been undertaken to assess structural earthquake damage.

This report is necessarily limited by the restricted ability to carry out inspections due to potential structural instabilities/safety considerations, and the time available to carry out such inspections. The report does not address defects that are not reasonably discoverable on visual inspection, including defects in inaccessible places and latent defects. Where site inspections were made, they were restricted to external inspections and, where practicable, limited internal visual inspections.

To carry out the structural review, existing building drawings were obtained from the Christchurch City Council records. We have assumed that the building has been constructed in accordance with the drawings.

While this report may assist the client in assessing whether the building should be repaired, strengthened or demolished that decision is the sole responsibility of the client.

This review has been prepared by Aurecon at the request of its client and is exclusively for the client's use. It is not possible to make a proper assessment of this review without a clear understanding of the terms of engagement under which it has been prepared, including the scope of the instructions and directions given to and the assumptions made by Aurecon. The report will not address issues which would need to be considered for another party if that party's particular circumstances, requirements and experience were known and, further, may make assumptions about matters of which a third party is not aware. No responsibility or liability to any third party is accepted for any loss or damage whatsoever arising out of the use of or reliance on this report by any third party.

Without limiting any of the above, Aurecon's liability, whether under the law of contract, tort, statute, equity or otherwise, is limited as set out in the terms of the engagement with the client.




Appendices



Appendix A

Site Map, Photos and Levels Survey Results

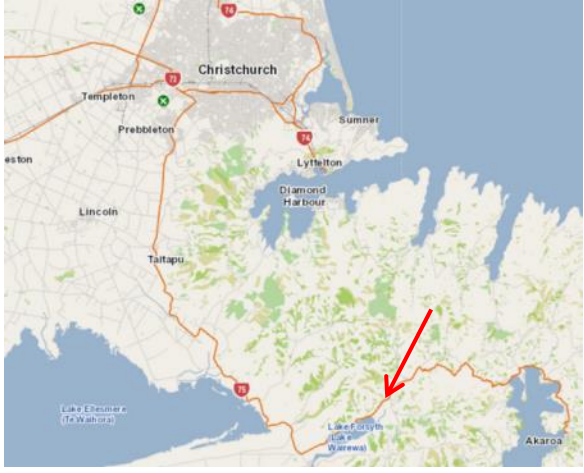9 May 2012 – Little River Fire Station Site Photographs

<p>Location of Little River fire station.</p>	
<p>Aerial photograph of Little River Fire Station.</p>	
<p>Building western elevation.</p>	


Building eastern elevation.



Building internal view.



Building internal view.

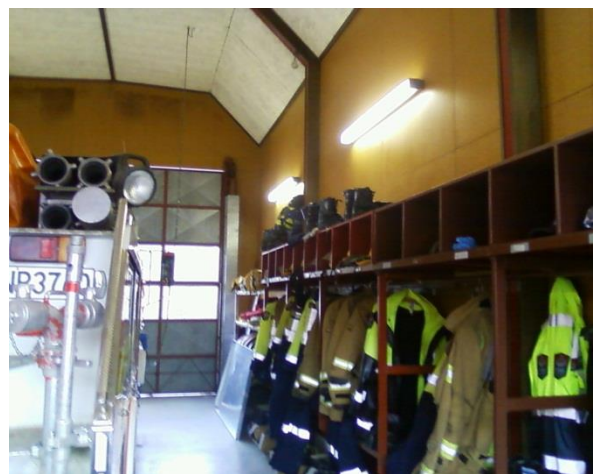

Base fixing detail of existing portal frames.



Typical knee joint of existing portal frames.





Appendix B

References

1. Department of Building and Housing (DBH), “Revised Guidance on Repairing and Rebuilding Houses Affected by the Canterbury Earthquake Sequence”, November 2011
2. New Zealand Society for Earthquake Engineering (NZSEE), “Assessment and Improvement of the Structural Performance of Buildings in Earthquakes”, April 2012
3. Standards New Zealand, “AS/NZS 1170 Part 0, Structural Design Actions: General Principles”, 2002
4. Standards New Zealand, “AS/NZS 1170 Part 1, Structural Design Actions: Permanent, imposed and other actions”, 2002
5. Standards New Zealand, “NZE 1170 Part 5, Structural Design Actions: Earthquake Actions – New Zealand”, 2004
6. Standards New Zealand, “NZE 3101 Part 1, The Design of Concrete Structures”, 2006
7. Standards New Zealand, “NZE 3404 Part 1, Steel Structures Standard”, 1997
8. Standards New Zealand, “NZE 3606, Timber Structures Standard”, 1993
9. Standards New Zealand, “NZE 3604, Timber Framed Structures”, 2011
10. Standards New Zealand, “NZE 4229, Concrete Masonry Buildings Not Requiring Specific Engineering Design”, 1999
11. Standards New Zealand, “NZE 4230, Design of Reinforced Concrete Masonry Structures”, 2004



Appendix C

Strength Assessment Explanation

New building standard (NBS)

New building standard (NBS) is the term used with reference to the earthquake standard that would apply to a new building of similar type and use if the building was designed to meet the latest design Codes of Practice. If the strength of a building is less than this level, then its strength is expressed as a percentage of NBS.

Earthquake Prone Buildings

A building can be considered to be earthquake prone if its strength is less than one third of the strength to which an equivalent new building would be designed, that is, less than 33%NBS (as defined by the New Zealand Building Act). If the building strength exceeds 33%NBS but is less than 67%NBS the building is considered at risk.

Christchurch City Council Earthquake Prone Building Policy 2010

The Christchurch City Council (CCC) already had in place an Earthquake Prone Building Policy (EPB Policy) requiring all earthquake-prone buildings to be strengthened within a timeframe varying from 15 to 30 years. The level to which the buildings were required to be strengthened was 33%NBS.

As a result of the 4 September 2010 Canterbury earthquake the CCC raised the level that a building was required to be strengthened to from 33% to 67% NBS but qualified this as a target level and noted that the actual strengthening level for each building will be determined in conjunction with the owners on a building-by-building basis. Factors that will be taken into account by the Council in determining the strengthening level include the cost of strengthening, the use to which the building is put, the level of danger posed by the building, and the extent of damage and repair involved.

Irrespective of strengthening level, the threshold level that triggers a requirement to strengthen is 33%NBS.

As part of any building consent application fire and disabled access provisions will need to be assessed.

Christchurch Seismicity

The level of seismicity within the current New Zealand loading code (AS/NZS 1170) is related to the seismic zone factor. The zone factor varies depending on the location of the building within NZ. Prior to the 22nd February 2011 earthquake the zone factor for Christchurch was 0.22. Following the earthquake the seismic zone factor (level of seismicity) in the Christchurch and surrounding areas has been increased to 0.3. This is a 36% increase.

For this assessment, the building's earthquake resistance is compared with the current New Zealand Building Code requirements for a new building constructed on the site. This is expressed as a percentage of new building standard (%NBS). The new building standard load requirements have been determined in accordance with the current earthquake loading standard (NZS 1170.5:2004 Structural design actions - Earthquake actions - New Zealand).

The likely capacity of this building has been derived in accordance with the New Zealand Society for Earthquake Engineering (NZSEE) guidelines 'Assessment and Improvement of the Structural Performance of Buildings in Earthquakes' (AISPBE), 2006. These guidelines provide an Initial Evaluation Procedure that assesses a buildings capacity based on a comparison of loading codes from when the building was designed

and currently. It is a quick high-level procedure that can be used when undertaking a Qualitative analysis of a building. The guidelines also provide guidance on calculating a modified Ultimate Limit State capacity of the building which is much more accurate and can be used when undertaking a Quantitative analysis.

The New Zealand Society for Earthquake Engineering has proposed a way for classifying earthquake risk for existing buildings in terms of %NBS and this is shown in Figure C1 below.

Description	Grade	Risk	%NBS	Existing Building Structural Performance	Improvement of Structural Performance	
					Legal Requirement	NZSEE Recommendation
Low Risk Building	A or B	Low	Above 67	Acceptable (improvement may be desirable)	The Building Act sets no required level of structural improvement (unless change in use) This is for each TA to decide. Improvement is not limited to 34%NBS.	100%NBS desirable. Improvement should achieve at least 67%NBS
Moderate Risk Building	B or C	Moderate	34 to 66	Acceptable legally. Improvement recommended		Not recommended. Acceptable only in exceptional circumstances
High Risk Building	D or E	High	33 or lower	Unacceptable (Improvement	Unacceptable	Unacceptable

Figure C1: NZSEE Risk Classifications Extracted from table 2.2 of the NZSEE 2006 AISPBE Guidelines

Table C1 below compares the percentage NBS to the relative risk of the building failing in a seismic event with a 10% probability of exceedance in 50 years (i.e. 0.2% in the next year). It is noted that the current seismic risk in Christchurch results in a 6% probability of exceedance in the next year.

Table C1: Relative Risk of Building Failure In A

Percentage of New Building Standard (%NBS)	Relative Risk (Approximate)
>100	<1 time
80-100	1-2 times
67-80	2-5 times
33-67	5-10 times
20-33	10-25 times
<20	>25 times



Appendix D

Background and Legal Framework

Background

Aurecon has been engaged by the Christchurch City Council (CCC) to undertake a detailed engineering evaluation of the building

This report is a Qualitative Assessment of the building structure, and is based on the Detailed Engineering Evaluation Procedure document (draft) issued by the Structural Advisory Group on 19 July 2011.

A qualitative assessment involves inspections of the building and a desktop review of existing structural and geotechnical information, including existing drawings and calculations, if available.

The purpose of the assessment is to determine the likely building performance and damage patterns, to identify any potential critical structural weaknesses or collapse hazards, and to make an initial assessment of the likely building strength in terms of percentage of new building standard (%NBS).

At the time of this report, no intrusive site investigation, detailed analysis, or modelling of the building structure had been carried out. Construction drawings were made available, and these have been considered in our evaluation of the building. The building description below is based on a review of the drawings and our visual inspections.

Compliance

This section contains a brief summary of the requirements of the various statutes and authorities that control activities in relation to buildings in Christchurch at present.

Canterbury Earthquake Recovery Authority (CERA)

CERA was established on 28 March 2011 to take control of the recovery of Christchurch using powers established by the Canterbury Earthquake Recovery Act enacted on 18 April 2011. This act gives the Chief Executive Officer of CERA wide powers in relation to building safety, demolition and repair. Two relevant sections are:


Section 38 – Works

This section outlines a process in which the chief executive can give notice that a building is to be demolished and if the owner does not carry out the demolition, the chief executive can commission the demolition and recover the costs from the owner or by placing a charge on the owners' land.

Section 51 – Requiring Structural Survey

This section enables the chief executive to require a building owner, insurer or mortgagee carry out a full structural survey before the building is re-occupied.

We understand that CERA will require a detailed engineering evaluation to be carried out for all buildings (other than those exempt from the Earthquake Prone Building definition in the Building Act). It is anticipated that CERA will adopt the Detailed Engineering Evaluation Procedure document (draft) issued by the Structural Advisory Group on 19 July 2011. This document sets out a methodology for both qualitative and quantitative assessments.



The qualitative assessment is a desk-top and site inspection assessment. It is based on a thorough visual inspection of the building coupled with a review of available documentation such as drawings and specifications. The quantitative assessment involves analytical calculation of the buildings strength and may require non-destructive or destructive material testing, geotechnical testing and intrusive investigation.

It is anticipated that factors determining the extent of evaluation and strengthening level required will include:

- The importance level and occupancy of the building
- The placard status and amount of damage
- The age and structural type of the building
- Consideration of any critical structural weaknesses
- The extent of any earthquake damage

Building Act

Several sections of the Building Act are relevant when considering structural requirements:

Section 112 – Alterations

This section requires that an existing building complies with the relevant sections of the Building Code to at least the extent that it did prior to any alteration. This effectively means that a building cannot be weakened as a result of an alteration (including partial demolition).

Section 115 – Change of Use

This section requires that the territorial authority (in this case Christchurch City Council (CCC)) be satisfied that the building with a new use complies with the relevant sections of the Building Code 'as near as is reasonably practicable'. Regarding seismic capacity 'as near as reasonably practicable' has previously been interpreted by CCC as achieving a minimum of 67%NBS however where practical achieving 100%NBS is desirable. The New Zealand Society for Earthquake Engineering (NZSEE) recommend a minimum of 67%NBS.

Section 121 – Dangerous Buildings


The definition of dangerous building in the Act was extended by the Canterbury Earthquake (Building Act) Order 2010, and it now defines a building as dangerous if:

- in the ordinary course of events (excluding the occurrence of an earthquake), the building is likely to cause injury or death or damage to other property; or
- in the event of fire, injury or death to any persons in the building or on other property is likely because of fire hazard or the occupancy of the building; or
- there is a risk that the building could collapse or otherwise cause injury or death as a result of earthquake shaking that is less than a 'moderate earthquake' (refer to Section 122 below); or
- there is a risk that that other property could collapse or otherwise cause injury or death; or
- a territorial authority has not been able to undertake an inspection to determine whether the building is dangerous.

Section 122 – Earthquake Prone Buildings

This section defines a building as earthquake prone if its ultimate capacity would be exceeded in a 'moderate earthquake' and it would be likely to collapse causing injury or death, or damage to other property. A moderate earthquake is defined by the building regulations as one that would generate ground shaking 33% of the shaking used to design an equivalent new building.

Section 124 – Powers of Territorial Authorities



This section gives the territorial authority the power to require strengthening work within specified timeframes or to close and prevent occupancy to any building defined as dangerous or earthquake prone.

Section 131 – Earthquake Prone Building Policy

This section requires the territorial authority to adopt a specific policy for earthquake prone, dangerous and insanitary buildings.

Christchurch City Council Policy

Christchurch City Council adopted their Earthquake Prone, Dangerous and Insanitary Building Policy in 2006. This policy was amended immediately following the Darfield Earthquake of the 4th September 2010.

The 2010 amendment includes the following:

- A process for identifying, categorising and prioritising Earthquake Prone Buildings, commencing on 1 July 2012;
- A strengthening target level of 67% of a new building for buildings that are Earthquake Prone;
- A timeframe of 15-30 years for Earthquake Prone Buildings to be strengthened; and,
- Repair works for buildings damaged by earthquakes will be required to comply with the above.

The council has stated their willingness to consider retrofit proposals on a case by case basis, considering the economic impact of such a retrofit.

We anticipate that any building with a capacity of less than 33%NBS (including consideration of critical structural weaknesses) will need to be strengthened to a target of 67%NBS of new building standard as recommended by the Policy.

If strengthening works are undertaken, a building consent will be required. A requirement of the consent will require upgrade of the building to comply 'as near as is reasonably practicable' with:

- The accessibility requirements of the Building Code.
- The fire requirements of the Building Code. This is likely to require a fire report to be submitted with the building consent application.


Building Code

The building code outlines performance standards for buildings and the Building Act requires that all new buildings comply with this code. Compliance Documents published by The Department of Building and Housing can be used to demonstrate compliance with the Building Code.

After the February Earthquake, on 19 May 2011, Compliance Document B1: Structure was amended to include increased seismic design requirements for Canterbury as follows:


- Hazard Factor increased from 0.22 to 0.3 (36% increase in the basic seismic design load)
- Serviceability Return Period Factor increased from 0.25 to 0.33 (80% increase in the serviceability design loads when combined with the Hazard Factor increase)

The increase in the above factors has resulted in a reduction in the level of compliance of an existing building relative to a new building despite the capacity of the existing building not changing.



Appendix E

Standard Reporting Spreadsheet



Appendix F

Strengthening Scheme

Detailed Engineering Evaluation Summary Data

V1.11

Location		Building Name: <u>Little River Fire Station</u>	Unit No: <u>Street</u>	Reviewer: <u>Mark Bellamy</u>
Building Address: <u>40 Western Valley Road</u>		CP/Eng No: <u>1025802</u>	Company: <u>Aurecon</u>	Company project number: <u>228601</u>
Legal Description: _____		Company phone number: <u>33750761</u>	Date of submission: <u>10/04/2014</u>	Inspection Date: <u>6/05/2013</u>
GPS south: <u>43</u> Degrees <u>49</u> Min <u>70</u> Sec		GPS east: <u>172</u> <u>47</u> <u>41.50</u>	Revision: <u>1</u>	Is there a full report with this summary? <u>Yes</u>
Building Unique Identifier (CC) <u>PRO 3663 B001</u>				

Site	Site slope: <u>flat</u>	Max retaining height (m): <u>0</u>
	Soil type: <u>mixed</u>	Soil Profile (if available): _____
	Site Class (to NZS1170.5): <u>D</u>	If Ground improvement on site, describe: _____
	Proximity to waterway (m, if <100m): _____	Approx site elevation (m): <u>1.00</u>
	Proximity to cliff top (m, if <100m): _____	
	Proximity to cliff base (m, if <100m): _____	

Building	No. of storeys above ground: <u>1</u>	single storey = 1	Ground floor elevation (Absolute) (m): _____
	Ground floor split: <u>no</u>		Ground floor elevation above ground (m): <u>0.00</u>
	Storeys below ground: <u>0</u>		
	Foundation type: <u>mat slab</u>		If Foundation type is other, describe: _____
	Building height (m): <u>5.50</u>	height from ground to level of uppermost seismic mass (for IEP only) (m): _____	
	Floor footprint area (approx): <u>130</u>		
	Age of Building (years): <u>35</u>		Date of design: <u>1976-1992</u>
	Strengthening present: <u>no</u>		If so, when (year)? _____
	Use (ground floor): <u>parking</u>		And what load level (%g)? _____
	Use (upper floors): _____		Brief strengthening description: _____
	Use notes (if required): _____		
	Importance level (to NZS1170.5): <u>IL4</u>		

Gravity Structure	Gravity System: <u>frame system</u>	rafter type, purlin type and cladding: _____
	Roof: <u>steel framed</u>	slab thickness (mm): _____
	Floors: <u>concrete flat slab</u>	overall depth x width (mm x mm): _____
	Beams: <u>none</u>	typical dimensions (mm x mm): _____
	Columns: <u>structural steel</u>	
	Walls: <u>non-load bearing</u>	

Lateral load resisting structure	Lateral system along: <u>other (note)</u>	Note: Define along and across in detailed report!	describe system: <u>timber framed, lined walls</u>
	Ductility assumed, μ: <u>3.00</u>		estimate or calculation: <u>estimated</u>
	Period along: <u>0.40</u>		estimate or calculation: _____
	Total deflection (ULS) (mm): _____		estimate or calculation: _____
	maximum interstorey deflection (ULS) (mm): _____		
	Lateral system across: <u>welded and bolted steel moment frame</u>		note typical bay length (m): _____
	Ductility assumed, μ: <u>3.00</u>		estimate or calculation: <u>estimated</u>
	Period across: <u>0.40</u>		estimate or calculation: _____
	Total deflection (ULS) (mm): _____		estimate or calculation: _____
	maximum interstorey deflection (ULS) (mm): _____		

Separations:	north (mm): _____	leave blank if not relevant
	east (mm): _____	
	south (mm): _____	
	west (mm): _____	

Non-structural elements	Stairs: _____	
	Wall cladding: _____	
	Roof Cladding: _____	
	Glazing: _____	
	Ceilings: _____	
	Services (list): _____	

Available documentation	Architectural: <u>partial</u>	original designer name/date: _____
	Structural: <u>none</u>	original designer name/date: _____
	Mechanical: <u>none</u>	original designer name/date: _____
	Electrical: <u>none</u>	original designer name/date: _____
	Geotech report: <u>none</u>	original designer name/date: _____

Damage Site: (refer DEE Table 4-2)	Site performance: <u>Good</u>	Describe damage: _____
	Settlement: <u>none observed</u>	notes (if applicable): _____
	Differential settlement: <u>0-1.350</u>	notes (if applicable): _____
	Liquefaction: <u>none apparent</u>	notes (if applicable): _____
	Lateral Spread: <u>none apparent</u>	notes (if applicable): _____
	Differential lateral spread: <u>none apparent</u>	notes (if applicable): _____
	Ground cracks: <u>none apparent</u>	notes (if applicable): _____
	Damage to area: <u>none apparent</u>	notes (if applicable): _____

Building:	Current Placard Status: <u>green</u>	
Along	Damage ratio: <u>0%</u>	Describe how damage ratio arrived at: _____
	Describe (summary): _____	
Across	Damage ratio: <u>0%</u>	$Damage_Ratio = \frac{(\%NBS\ (before) - \%NBS\ (after))}{\%NBS\ (before)}$
	Describe (summary): _____	
Diaphragms	Damage?: <u>no</u>	Describe: _____
CSWs:	Damage?: <u>no</u>	Describe: _____
Pounding:	Damage?: <u>no</u>	Describe: _____
Non-structural:	Damage?: <u>no</u>	Describe: _____

Recommendations	Level of repair/strengthening required: <u>significant structural and strengthening</u>	Describe: <u>Recommend strengthening</u>
	Building Consent required: <u>yes</u>	Describe: _____
	Interim occupancy recommendations: <u>full occupancy</u>	Describe: _____
Along	Assessed %NBS before e'quakes: _____	100% ##### %NBS from IEP below
	Assessed %NBS after e'quakes: _____	100%
Across	Assessed %NBS before e'quakes: _____	38% ##### %NBS from IEP below
	Assessed %NBS after e'quakes: _____	38%

IEP	Use of this method is not mandatory - more detailed analysis may give a different answer, which would take precedence. Do not fill in fields if not using IEP.	
Period of design of building (from above): <u>1976-1992</u>		h _n from above: m _____
Seismic Zone, if designed between 1965 and 1992: _____		not required for this age of building not required for this age of building
	along: <u>0.4</u>	across: <u>0.4</u>
	(%NBS)nom from Fig 3.3: _____	
Note:1 for specifically design public buildings, to the code of the day: pre-1965 = 1.25; 1965-1976, Zone A = 1.33; 1965-1976, Zone B = 1.2; all else _____		1.0
Note 2: for RC buildings designed between 1976-1984, use 1.2 _____		1.0
Note 3: for buildings designed prior to 1935 use 0.8, except in Wellington (1.0) _____		1.0
	along: <u>0%</u>	across: <u>0%</u>
	Final (%NBS) _{nom} : _____	

2.2 Near Fault Scaling Factor

Near Fault scaling factor, from NZS1170.5, cl 3.1.6

	along	across
Near Fault scaling factor (1/N(T,D), Factor A:	#DIV/0!	#DIV/0!

2.3 Hazard Scaling Factor

Hazard factor Z for site from AS1170.5, Table 3.3

Z ₁₉₉₂ , from NZS4203:1992	
Hazard scaling factor, Factor B:	#DIV/0!

2.4 Return Period Scaling Factor

Building Importance level (from above)

Return Period Scaling factor from Table 3.1 Factor C:	2
---	---

2.5 Ductility Scaling Factor

Assessed ductility (less than max in Table 3.2) along across
 Ductility scaling factor: =1 from 1976 onwards; or = μ , if pre-1976, from Table 3.3

Ductility Scaling Factor, Factor D:	1.00	1.00
-------------------------------------	------	------

2.6 Structural Performance Scaling Factor:

Sp:		
Structural Performance Scaling Factor Factor E:	#DIV/0!	#DIV/0!

2.7 Baseline %NBS, (NBS)_b = (%NBS)_{nom} x A x B x C x D x E

%NBS_b:

Global Critical Structural Weaknesses: (refer to NZSEE IEP Table 3.4)

3.1. Plan Irregularity, factor A:	insignificant	1
3.2. Vertical irregularity, Factor B:	insignificant	1
3.3. Short columns, Factor C:	insignificant	1
3.4. Pounding potential	Pounding effect D1, from Table to right: 1.0 Height Difference effect D2, from Table to right: 1.0	
	Therefore, Factor D:	1
3.5. Site Characteristics	insignificant	1

Table for selection of D1	Severe	Significant	Insignificant/none
	Separation	0<sep<.005H	.005<sep<.01H
Alignment of floors within 20% of H	0.7	0.8	1
Alignment of floors not within 20% of H	0.4	0.7	0.8

Table for Selection of D2	Severe	Significant	Insignificant/none
	Separation	0<sep<.005H	.005<sep<.01H
Height difference > 4 storeys	0.4	0.7	1
Height difference 2 to 4 storeys	0.7	0.9	1
Height difference < 2 storeys	1	1	1

3.6 Other factors, Factor F

For ≤ 3 storeys, max value =2.5, otherwise max value =1.5, no minimum
 Rationale for choice of F factor, if not

Detail Critical Structural Weaknesses: (refer to DEE Procedure section 6)	
List any:	Refer also section 6.3.1 of DEE for discussion of F factor modification for other critical structural weaknesses

3.7 Overall Performance Achievement ratio (PAR)

	0.00	0.00
--	------	------

4.3 PAR x (%NBS)_b:

PAR x Baseline %NBS

	#DIV/0!	#DIV/0!
--	---------	---------

4.4 Percentage New Building Standard (%NBS), (before)

	#DIV/0!
--	---------



Aurecon New Zealand Limited

**Level 2, 518 Colombo Street
Christchurch Central**

PO Box 1061
Christchurch 8140
New Zealand

T +64 3 375 0761

F +64 3 379 6955

E christchurch@aurecongroup.com

W aurecongroup.com

Aurecon offices are located in:

Angola, Australia, Botswana, China,
Ethiopia, Hong Kong, Indonesia,
Lesotho, Libya, Malawi, Mozambique,
Namibia, New Zealand, Nigeria,
Philippines, Singapore, South Africa,
Swaziland, Tanzania, Thailand, Uganda,
United Arab Emirates, Vietnam.