

Christchurch City Council
PRK_2004_BLDG_017 EQ2
Garage - Rawhiti Golf Course
35-37 Bowhill Rd



QUALITATIVE ASSESSMENT REPORT

FINAL

- Rev B
- 23 May 2013



Christchurch City Council
PRK_2004_BLDG_017 EQ2
Garage - Rawhiti Golf Course
35-37 Bowhill Rd
QUALITATIVE ASSESSMENT REPORT

FINAL

- Rev B
- 23 May 2013

Sinclair Knight Merz
142 Sherborne Street
Saint Albans
PO Box 21011, Edgeware
Christchurch, New Zealand
Tel: +64 3 940 4900
Fax: +64 3 940 4901
Web: www.skmconsulting.com

COPYRIGHT: The concepts and information contained in this document are the property of Sinclair Knight Merz Limited. Use or copying of this document in whole or in part without the written permission of Sinclair Knight Merz constitutes an infringement of copyright.

LIMITATION: This report has been prepared on behalf of and for the exclusive use of Sinclair Knight Merz Limited's Client, and is subject to and issued in connection with the provisions of the agreement between Sinclair Knight Merz and its Client. Sinclair Knight Merz accepts no liability or responsibility whatsoever for or in respect of any use of or reliance upon this report by any third party.

Contents

1.	Executive Summary	1
1.1.	Background	1
1.2.	Key Damage Observed	2
1.3.	Critical Structural Weaknesses	2
1.4.	Indicative Building Strength (from IEP and CSW assessment)	2
1.5.	Recommendations	2
2.	Introduction	3
3.	Compliance	4
3.1.	Canterbury Earthquake Recovery Authority (CERA)	4
3.2.	Building Act	5
3.3.	Christchurch City Council Policy	6
3.4.	Building Code	7
4.	Earthquake Resistance Standards	8
5.	Building Details	10
5.1.	Building description	10
5.2.	Gravity Load Resisting system	10
5.3.	Seismic Load Resisting system	10
5.4.	Geotechnical Conditions	10
6.	Damage Summary	11
7.	Initial Seismic Evaluation	12
7.1.	The Initial Evaluation Procedure Process	12
7.2.	Design Criteria and Limitations	14
7.3.	Survey	14
7.4.	Critical Structural Weaknesses	14
7.5.	Qualitative Assessment Results	15
8.	Further Investigation	16
9.	Conclusion	17
10.	Limitation Statement	18
11.	Appendix 1 – Photos	19
12.	Appendix 2 – IEP Reports	23
13.	Appendix 3 – CERA Standardised Report Form	30



Document history and status

Revision	Date issued	Reviewed by	Approved by	Date approved	Revision type
A	21/12/2012	N Calvert	N Calvert	21/12/2012	Draft for Client Approval
B	23/05/2013	N Calvert	N Calvert	23/05/2013	Final Issue

Approval

	Signature	Date	Name	Title
Author		23/05/2013	Nigel Chan	Structural Engineer
Approver		23/05/2013	Nick Calvert	Senior Structural Engineer

Distribution of copies

Revision	Copy no	Quantity	Issued to
A	1	1	Christchurch City Council
B	1	1	Christchurch City Council

Printed:	23 May 2013
Last saved:	22 May 2013 02:37 PM
File name:	PRK 2004 BLDG 017 Rawhiti Domain Garage Rawhiti Golf Course Qualitative Final.docx
Author:	Nigel Chan
Project manager:	Alex Martin
Name of organisation:	Christchurch City Council
Name of project:	Christchurch City Council Structures Panel
Name of document:	ZB01276.187.PRK_2004_BLDG_017 EQ2.Quantitative.Assmt.A.docx
Document version:	B
Project number:	ZB01276.187

1. Executive Summary

1.1. Background

A Qualitative Assessment was carried out on the building PRK_2004_BLDG_017 EQ2 located at Rawhiti Golf Course, 35-37 Bowhill Road. The building located on this site is a single storey masonry building with internal steel portal frames which is used as an office, toilet, garage and soil storage facility. An aerial photograph showing the location of the building is shown below in Figure 1. Detailed descriptions outlining the buildings age and construction type are given in Section 5 of this report.



■ Figure 1 Aerial Photograph of Rawhiti Golf Course Garage

The qualitative assessment includes a summary of the building damage as well as an initial assessment of the current seismic capacity compared with current seismic code loads using the Initial Evaluation Procedure (IEP).

This Qualitative report for the building structure is based on the Detailed Engineering Evaluation Procedure document (draft) issued by the Structural Advisory Group on 19 July 2011, and a visual inspection on 22/11/12.



1.2. Key Damage Observed

Key damage observed includes:-

- 0.6mm step cracks through the masonry grout on the transverse walls close to the garage door openings

Repair recommendations for the damage above are included in section 6.

1.3. Critical Structural Weaknesses

No potential critical structural weaknesses have been identified.

1.4. Indicative Building Strength (from IEP and CSW assessment)

Based on the information available, and using the NZSEE Initial Evaluation Procedure, the buildings original capacity has been assessed to be in the order of 55%NBS and post earthquake capacity in the order of 55%NBS. This assessment has been made without structural drawings and is accordingly limited.

The building has been assessed to have a seismic capacity in the order of 55% NBS and is therefore not potentially earthquake prone.

1.5. Recommendations

It is recommended that:

- a) There is no damage to the building that would cause it to be unsafe to occupy.
- b) A quantitative assessment of the building, supported by intrusive investigations if required, be undertaken to determine the seismic capacity and to develop potential strengthening concepts.
- c) We consider that barriers around the building are not necessary.

2. Introduction

Sinclair Knight Merz was engaged by Christchurch City Council to prepare a qualitative assessment report for the building located at 35-37 Bowhill Road following the magnitude 6.3 earthquake which occurred in the afternoon of the 22nd of February 2011 and the subsequent aftershocks.

The Qualitative Assessment uses the methodology recommended in the Engineering Advisory Group document “Guidance on Detailed Engineering Evaluation of Earthquake affected Non-residential Buildings in Canterbury” (part 2 revision 5 dated 19/07/2011 and part 3 draft revision dated 13/12/2011). The qualitative assessment includes a summary of the building damage as well as an initial assessment of the likely current Seismic Capacity compared with current seismic code requirements.

A qualitative assessment involves inspections of the building and a desktop review of existing structural and geotechnical information, including existing drawings and calculations, if available.

The purpose of the assessment is to determine the likely building performance and damage patterns, to identify any potential critical structural weaknesses or collapse hazards, and to make an initial assessment of the likely building strength in terms of percentage of new building standard (%NBS).

This report describes the structural damage observed during our inspection and indicates suggested remediation measures. The inspection was undertaken from floor levels and was a visual inspection only. Our report reflects the situation at the time of the inspection and does not take account of changes caused by any events following our inspection. A full description of the basis on which we have undertaken our visual inspection is set out in section 7.

The NZ Society for Earthquake Engineering (NZSEE) Initial Evaluation Procedure (IEP) was used to assess the likely performance of the building in a seismic event relative to the New Building Standard (NBS). 100% NBS is equivalent to the strength of a building that fully complies with current codes. This includes a recent increase of the Christchurch seismic hazard factor from 0.22 to 0.3¹.

At the time of this report, no intrusive site investigation, detailed analysis, or modelling of the building structure had been carried out. Construction drawings were not made available. The building description below is based on our visual inspections.

¹ <http://www.dbh.govt.nz/seismicity-info>

3. Compliance

This section contains a summary of the requirements of the various statutes and authorities that control activities in relation to buildings in Christchurch at present.

3.1. Canterbury Earthquake Recovery Authority (CERA)

CERA was established on 28 March 2011 to take control of the recovery of Christchurch using powers established by the Canterbury Earthquake Recovery Act enacted on 18 April 2011. This act gives the Chief Executive Officer of CERA wide powers in relation to building safety, demolition and repair. Two relevant sections are:

Section 38 – Works

This section outlines a process in which the chief executive can give notice that a building is to be demolished and if the owner does not carry out the demolition, the chief executive can commission the demolition and recover the costs from the owner or by placing a charge on the owners' land.

Section 51 – Requiring Structural Survey

This section enables the chief executive to require a building owner, insurer or mortgagee carry out a full structural survey before the building is re-occupied.

We understand that CERA will require a detailed engineering evaluation to be carried out for all buildings (other than those exempt from the Earthquake Prone Building definition in the Building Act). It is anticipated that CERA will adopt the Detailed Engineering Evaluation Procedure document (draft) issued by the Structural Advisory Group on 19 July 2011. This document sets out a methodology for both qualitative and quantitative assessments.

The qualitative assessment is a desk-top and site inspection assessment. It is based on a thorough visual inspection of the building coupled with a review of available documentation such as drawings and specifications. The quantitative assessment involves analytical calculation of the buildings strength and may require non-destructive or destructive material testing, geotechnical testing and intrusive investigation.

It is anticipated that factors determining the extent of evaluation and strengthening level required will include:

- The importance level and occupancy of the building
- The placard status and amount of damage
- The age and structural type of the building
- Consideration of any critical structural weaknesses

- The extent of any earthquake damage

3.2. Building Act

Several sections of the Building Act are relevant when considering structural requirements:

3.2.1. Section 112 – Alterations

This section requires that an existing building complies with the relevant sections of the Building Code to at least the extent that it did prior to any alteration. This effectively means that a building cannot be weakened as a result of an alteration (including partial demolition).

3.2.2. Section 115 – Change of Use

This section requires that the territorial authority (in this case Christchurch City Council (CCC)) be satisfied that the building with a new use complies with the relevant sections of the Building Code 'as near as is reasonably practicable'. Regarding seismic capacity 'as near as reasonably practicable' has previously been interpreted by CCC as achieving a minimum of 67%NBS however where practical achieving 100%NBS is desirable. The New Zealand Society for Earthquake Engineering (NZSEE) recommend a minimum of 67%NBS.

3.2.3. Section 121 – Dangerous Buildings

The definition of dangerous building in the Act was extended by the Canterbury Earthquake (Building Act) Order 2010, and it now defines a building as dangerous if:

- in the ordinary course of events (excluding the occurrence of an earthquake), the building is likely to cause injury or death or damage to other property; or
- in the event of fire, injury or death to any persons in the building or on other property is likely because of fire hazard or the occupancy of the building; or
- there is a risk that the building could collapse or otherwise cause injury or death as a result of earthquake shaking that is less than a 'moderate earthquake' (refer to Section 122 below); or
- there is a risk that that other property could collapse or otherwise cause injury or death; or
- a territorial authority has not been able to undertake an inspection to determine whether the building is dangerous.

3.2.4. Section 122 – Earthquake Prone Buildings

This section defines a building as earthquake prone if its ultimate capacity would be exceeded in a 'moderate earthquake' and it would be likely to collapse causing injury or death, or damage to other property. A moderate earthquake is defined by the building regulations as one that would generate ground shaking 33% of the shaking used to design an equivalent new building.

3.2.5. Section 124 – Powers of Territorial Authorities

This section gives the territorial authority the power to require strengthening work within specified timeframes or to close and prevent occupancy to any building defined as dangerous or earthquake prone.

3.2.6. Section 131 – Earthquake Prone Building Policy

This section requires the territorial authority to adopt a specific policy for earthquake prone, dangerous and insanitary buildings.

3.3. Christchurch City Council Policy

Christchurch City Council adopted their Earthquake Prone, Dangerous and Insanitary Building Policy in 2006. This policy was amended immediately following the Darfield Earthquake of the 4th September 2010.

The 2010 amendment includes the following:

- A process for identifying, categorising and prioritising Earthquake Prone Buildings, commencing on 1 July 2012;
- A strengthening target level of 67% of a new building for buildings that are Earthquake Prone. Council recognises that it may not be practicable for some repairs to meet that target. The council will work closely with building owners to achieve sensible, safe outcomes;
- A timeframe of 15-30 years for Earthquake Prone Buildings to be strengthened; and,
- Repair works for buildings damaged by earthquakes will be required to comply with the above.

The council has stated their willingness to consider retrofit proposals on a case by case basis, considering the economic impact of such a retrofit.

We anticipate that any building with a capacity of less than 34%NBS (including consideration of critical structural weaknesses) will need to be strengthened to a target of 67%NBS of new building standard as recommended by the Policy.

If strengthening works are undertaken, a building consent will be required. A requirement of the consent will require upgrade of the building to comply 'as near as is reasonably practicable' with:

- The accessibility requirements of the Building Code.
- The fire requirements of the Building Code. This is likely to require a fire report to be submitted with the building consent application.



3.4. Building Code

The building code outlines performance standards for buildings and the Building Act requires that all new buildings comply with this code. Compliance Documents published by The Department of Building and Housing can be used to demonstrate compliance with the Building Code.

After the February Earthquake, on 19 May 2011, Compliance Document B1: Structure was amended to include increased seismic design requirements for Canterbury as follows:

- a) Hazard Factor increased from 0.22 to 0.3 (36% increase in the basic seismic design load)
- b) Serviceability Return Period Factor increased from 0.25 to 0.33 (80% increase in the serviceability design loads when combined with the Hazard Factor increase)

The increase in the above factors has resulted in a reduction in the level of compliance of an existing building relative to a new building despite the capacity of the existing building not changing.



4. Earthquake Resistance Standards

For this assessment, the building's earthquake resistance is compared with the current New Zealand Building Code requirements for a new building constructed on the site. This is expressed as a percentage of new building standard (%NBS). The new building standard load requirements have been determined in accordance with the current earthquake loading standard (NZS 1170.5:2004 Structural design actions - Earthquake actions - New Zealand).

The likely capacity of this building has been derived in accordance with the New Zealand Society for Earthquake Engineering (NZSEE) guidelines 'Assessment and Improvement of the Structural Performance of Buildings in Earthquakes' (AISPBE), 2006. These guidelines provide an Initial Evaluation Procedure that assesses a buildings capacity based on a comparison of loading codes from when the building was designed and currently. It is a quick high-level procedure that can be used when undertaking a Qualitative analysis of a building. The guidelines also provide guidance on calculating a modified Ultimate Limit State capacity of the building which is much more accurate and can be used when undertaking a Quantitative analysis.

The New Zealand Society for Earthquake Engineering has proposed a way for classifying earthquake risk for existing buildings in terms of %NBS and this is shown in Figure 2 below.

Description	Grade	Risk	%NBS	Existing Building Structural Performance	Improvement of Structural Performance	
					Legal Requirement	NZSEE Recommendation
Low Risk Building	A or B	Low	Above 67	Acceptable (improvement may be desirable)	The Building Act sets no required level of structural improvement (unless change in use) This is for each TA to decide. Improvement is not limited to 34%NBS.	100%NBS desirable. Improvement should achieve at least 67%NBS
Moderate Risk Building	B or C	Moderate	34 to 66	Acceptable legally. Improvement recommended		Not recommended. Acceptable only in exceptional circumstances
High Risk Building	D or E	High	33 or lower	Unacceptable (Improvement)	Unacceptable	Unacceptable

■ **Figure 2: NZSEE Risk Classifications Extracted from table 2.2 of the NZSEE 2006 AISPBE Guidelines**

Table 1 below provides an indication of the risk of failure for an existing building with a given percentage NBS, relative to the risk of failure for a new building that has been designed to meet current Building Code criteria (the annual probability of exceedance specified by current earthquake design standards for a building of 'normal' importance is 1/500, or 0.2% in the next year, which is equivalent to 10% probability of exceedance in the next 50 years).



■ **Table 1: %NBS compared to relative risk of failure**

Percentage of New Building Standard (%NBS)	Relative Risk (Approximate)
>100	<1 time
80-100	1-2 times
67-80	2-5 times
33-67	5-10 times
20-33	10-25 times
<20	>25 times

5. Building Details

5.1. Building description

The building PRK_2004_BLDG_017 EQ2 is located at Rawhiti Golf Course, 35-37 Bowhill Road. The building located on this site is a single storey masonry building with internal steel portal frames which is used as an office, toilet, garage and soil storage facility. The roof is timber frame clad with corrugated metal.

Our evaluation is based on visual inspections carried out on 22 November 2012. Drawings of the building were not made available. Based on the details of the building we have assumed the building was constructed in the 1980's and therefore have assumed a design period of 1976-1992 for the purposes of the IEP.

5.2. Gravity Load Resisting system

The gravity load resisting structure of the building is made up of masonry block walls and internal steel portal frames for the 3 bay garage space. These are supported by the concrete slab on grade foundation, which also creates the ground floor area.

5.3. Seismic Load Resisting system

For the purposes of this report the longitudinal direction of the building is defined as being the east-west direction and the transverse direction is defined as being in the north-south direction.

Lateral loads on the building are carried by steel portal frames and masonry walls in both directions. Flat steel braces in the roof between the steel portal frames act to efficiently distribute lateral loads in the longitudinal direction. These lateral loads are then transferred to the concrete slab on ground foundation.

5.4. Geotechnical Conditions

Geotechnical assumptions were assumed for this site, these include.

- The site has been assessed as NZS1170.5 Class D (deep or soft soil) from adjacent borehole logs.
- It is expected that the allowable bearing capacity of a shallow pad footing on this site will be in the region of 200 kPa. We estimate a conservative ultimate bearing capacity to be in the order of 400 kPa. However, these may be revised by a site specific investigation.
- Liquefaction risk is low at this site.



6. Damage Summary

SKM undertook a visual inspection on 22nd November 2012. The following areas of damage were observed during the time of inspection:

- 1) 0.5mm-0.6mm step cracks through the masonry grout on the transverse walls close to the garage door openings

Photos of the above damage can be found in Appendix 1 – Photos.

7. Initial Seismic Evaluation

7.1. The Initial Evaluation Procedure Process

This section covers the initial seismic evaluation of the building as detailed in the NZSEE 'Assessment and Improvement of the Structural Performance of Buildings in Earthquakes'. The IEP grades buildings according to their likely performance in a seismic event. The procedure is not yet recognised by the NZ Building Code but is widely used and recognised by the Christchurch City Council as the preferred method for preliminary seismic investigations of buildings².

The IEP is a coarse screening process designed to identify buildings that are likely to be earthquake prone. The IEP process ranks buildings according to how well they are likely to perform relative to a new building designed to current earthquake standards, as shown in Table 2. The building grade is indicated by the percent of the required New Building Standard (%NBS) strength that the building is considered to have. A building is earthquake prone for the purposes of this Act if, having regard to its condition and to the ground on which it is built, and because of its construction, the building—

- a) will have its ultimate capacity exceeded in a moderate earthquake (as defined in the regulations); and
- b) would be likely to collapse causing—
 - i. injury or death to persons in the building or to persons on any other property; or
 - ii. damage to any other property.

A moderate earthquake is defined as 'in relation to a building, an earthquake that would generate shaking at the site of the building that is of the same duration as, but that is one-third as strong as, the earthquake shaking (determined by normal measures of acceleration, velocity and displacement) that would be used to design a new building at the site.'

An earthquake prone building will have an increased risk that its strength will be exceeded due to earthquake actions of approximately 10 times (or more) than that of a building having a capacity in excess of 100% NBS (refer Table 1)³. Buildings in Christchurch City that are identified as being earthquake prone are required by law to be followed up with a detailed assessment and strengthening work within 30 years of the owner being notified that the building is potentially earthquake prone⁴.

² <http://resources.ccc.govt.nz/files/EarthquakeProneDangerousAndInsanitaryBuildingsPolicy2010.pdf>

³ NZSEE June 2006, *Assessment and Improvement of the Structural Performance of Buildings in Earthquakes*, p 2-13

⁴ <http://resources.ccc.govt.nz/files/EarthquakeProneDangerousAndInsanitaryBuildingsPolicy2010.pdf>



Table 2: IEP Risk classifications

Description	Grade	Risk	%NBS	Structural performance
Low risk building	A+	Low	> 100	Acceptable. Improvement may be desirable.
	A		100 to 80	
	B		80 to 67	
Moderate risk building	C	Moderate	67 to 33	Acceptable legally. Improvement recommended.
High risk building	D	High	33 to 20	Unacceptable. Improvement required.
	E		< 20	

The IEP is a simple desktop study that is useful for risk management. No detailed calculations are done and so it relies on an inspection of the building and its plans to identify the structural members and describe the likely performance of the building in a seismic event. A review of the plans is also likely to identify any critical structural weaknesses. The IEP assumes that the building was properly designed and built according to the relevant codes at the time of construction. The IEP method rates buildings based on the code used at the time of construction and some more subjective parameters associated with how the building is detailed and so it is possible that %NBS derived from different engineers may differ.

This assessment describes only the likely seismic Ultimate Limit State (ULS) performance of the building. The ULS is the level of earthquake that can be resisted by the building without collapse or other forms of failure. The IEP does not attempt to estimate Serviceability Limit State (SLS) performance of the building, or the level of earthquake that would start to cause damage to the building⁵. This assessment concentrates on matters relating to life safety as damage to the building is a secondary consideration.

The NZ Building Code describes that the relevant codes for determining %NBS are primarily:

- AS/NZS 1170 Structural Design Actions
- NZS 3101:2006 Concrete Structures Standard
- NZS 3404:1997 Steel Structures Standard
- NZS4230:2004 Design of Reinforced Concrete Masonry Structures
- NZS 3603:1993 Timber Structures Standard
- NZS 3604:2011 Timber Framed Buildings

⁵ NZSEE 2006, *Assessment and Improvement of the Structural Performance of Buildings in Earthquakes*, p2-9

7.2. Design Criteria and Limitations

Following our inspection on the 22nd November 2012, SKM carried out a preliminary structural review. The structural review was undertaken using the available information which was as follows:

- SKM site measurements and inspection findings of the building. Please note no intrusive investigations were undertaken.
- Structural drawings were not available

The design criteria used to undertake the assessment include:

- Standard design assumptions for typical office and factory buildings as described in AS/NZS1170.0:2002
 - 50 year design life, which is the default NZ Building Code design life.
 - Structure importance level 2. This level of importance is described as ‘normal’ with medium or considerable consequence of failure.
 - Ductility level of 1, based on our assessment and code requirements at the time of design. This represents an elastic structure which is appropriate as we cannot confirm if there is reinforcing in the masonry walls.
 - Site hazard factor, $Z = 0.3$, NZBC, Clause B1 Structure, Amendment 11 effective from 1 August 2011

This IEP was based on our visual inspection of the building and a review of the available structural drawings. Since it is not a full design and construction review, it has the following limitations:

- It is not likely to pick up on any original design or construction errors (if they exist)
- Other possible issues that could affect the performance of the building such as corrosion and modifications to the building will not be identified
- The IEP deals only with the structural aspects of the building. Other aspects such as building services are not covered.
- The IEP does not involve a detailed analysis or an element by element code compliance check.

7.3. Survey

There was no visible settlement of the structure, nor was there any significant ground movement issues around the building. The building is adjacent to land which is zoned TC2 under the CERA Residential Technical Categories Map. The combination of these factors means that we do not recommend that any survey be undertaken at this point.

7.4. Critical Structural Weaknesses

No critical structural weaknesses were identified in the visual inspection



7.5. Qualitative Assessment Results

The building has had its capacity assessed using the Initial Evaluation Procedure based on the information available. The buildings capacity expressed as a percentage of new building standard (%NBS) is shown below in Table 3. This capacity is subject to confirmation by a quantitative analysis.

Table 3: Qualitative Assessment Summary

<u>Item</u>	<u>%NBS</u>
Rawhiti Domain Garage	55

Our qualitative assessment found that the building is likely to be classed as a 'Moderate risk building' (capacity between 33% and 67% NBS). The full IEP assessment form is detailed in Appendix 2 – IEP Reports.

Further investigation is required to confirm our initial findings and establish possible strengthening concepts.

8. Further Investigation

Due to the lack of structural drawings and the likely seismic capacity of the building being less than 67% NBS we recommend that a quantitative assessment is carried out due to the potential margin of errors that may be inherent in our initial assessment. This investigation will entail looking at the characteristics of each structural area in more detail to determine if there is sufficient capacity in the structural elements to resist the required earthquake demand. A geotechnical investigation is also required to complete the quantitative assessment. If the building is confirmed to be earthquake prone a seismic strengthening concept design should be prepared so that a pre-feasibility cost estimate can be prepared. The pre-feasibility strengthening cost estimate should then be compared with an estimate to demolish and rebuild the building so that the cost-effectiveness of repairing the building can be determined. Intrusive investigations will be required to confirm the following structural details.

- Foundations
- Sizes of structural roof members
- Connection sizes and layouts

9. Conclusion

A qualitative assessment was carried out on the building PRK_2004_BLDG_017 EQ2 located at Rawhiti Golf Course, 35-37 Bowhill Road. The building has sustained minor damage to the masonry walls.

The building has been assessed to have a seismic capacity in the order of 55% NBS and is therefore not potentially earthquake prone and is likely to be classified as a 'Moderate Risk Building' (capacity between 33% and 67% of NBS).

Further investigation is required to confirm our initial findings and to establish possible strengthening concepts. This investigation will require carrying out a quantitative assessment on the entire building to determine if there is enough capacity in the structural elements to resist the required earthquake demand.

It is recommended that:

- a) There is no damage to the building that would cause it to be unsafe to occupy.
- b) A quantitative assessment of the building, supported by intrusive investigations if required, be undertaken to determine the seismic capacity and to develop potential strengthening concepts.
- c) We consider that barriers around the building are not necessary.



10. Limitation Statement

This report has been prepared on behalf of, and for the exclusive use of, SKM's client, and is subject to, and issued in accordance with, the provisions of the contract between SKM and the Client. It is not possible to make a proper assessment of this report without a clear understanding of the terms of engagement under which it has been prepared, including the scope of the instructions and directions given to, and the assumptions made by, SKM. The report may not address issues which would need to be considered for another party if that party's particular circumstances, requirements and experience were known and, further, may make assumptions about matters of which a third party is not aware. No responsibility or liability to any third party is accepted for any loss or damage whatsoever arising out of the use of or reliance on this report by any third party.

Without limiting any of the above, in the event of any liability, SKM's liability, whether under the law of contract, tort, statute, equity or otherwise, is limited in as set out in the terms of the engagement with the Client.

It is not within SKM's scope or responsibility to identify the presence of asbestos, nor the responsibility of SKM to identify possible sources of asbestos. Therefore for any property pre-dating 1989, the presence of asbestos materials should be considered when costing remedial measures or possible demolition.

There is a risk of further movement and increased cracking due to subsequent aftershocks or settlement.

Should there be any further significant earthquake event, of a magnitude 5 or greater, it will be necessary to conduct a follow-up investigation, as the observations, conclusions and recommendations of this report may no longer apply. Earthquake of a lower magnitude may also cause damage, and SKM should be advised immediately if further damage is visible or suspected.

11. Appendix 1 – Photos



Photo 1: View of garage



Photo 2: North Elevation



Photo 3: West Elevation



Photo 4: South Elevation (1)



Photo 5: South Elevation (2)



Photo 6: East Elevation



Photo 7: View of one of the entrances to the 3 bay garage



Photo 8: Close up view from photo 7



Photo 9: Close up view from photo 8 showing 0.6mm step cracks through masonry grout.



Photo 10: Interior view of 3 bay garage



Photo 11: Interior view of 3 bay garage showing roof structure (1)



Photo 12: Interior view of 3 bay garage showing roof structure (2)



Photo 13: Interior view of 3 bay garage showing roof structure (3)



Photo 14: Masonry wall inside of 3 bay garage



Photo 15: Close up view from photo 14 showing 0.5mm step cracks through masonry grout



Photo 16: Entrance to office on east side of building



Photo 17: Interior view of office



Photo 18: Soil storage area on South side of building



Photo 19: Interior view of soil storage area



Photo 20: Exterior view of soil storage area



12. Appendix 2 – IEP Reports

Table IEP-1 Initial Evaluation Procedure – Step 1
 (Refer Table IEP - 2 for Step 2; Table IEP - 3 for Step 3, Table IEP - 4 for Steps 4, 5 and 6)


Building Name:	<u>Garage - Rawhiti Golf Course (PRK_2004_BLDG_017 EQ2)</u>	Ref.	<u>ZB01276.187</u>
Location:	<u>Bowhill Rd 35 - 37</u>	By	<u>NLC</u>
		Date	<u>23/05/2013</u>

Step 1 - General Information

1.1 Photos (attach sufficient to describe building)



1.2 Sketch of building plan

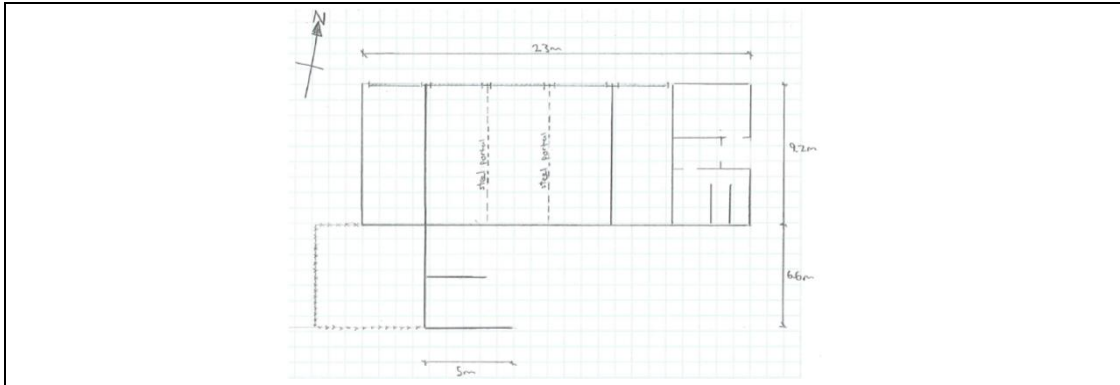

1.3 List relevant features

Structure is a single storey masonry structure with internal steel portal frames in the transverse direction, with a timber framed roof. Foundation is a concrete slab. The building is used as a garage, office, toilet and a soil storage facility.

1.4 Note information sources

- Visual Inspection of Exterior
- Visual Inspection of Interior
- Drawings (note type)
- Specifications
- Geotechnical Reports
- Other (list)

Tick as appropriate

<input checked="" type="checkbox"/>
<input checked="" type="checkbox"/>
<input type="checkbox"/>
<input type="checkbox"/>
<input type="checkbox"/>
<input type="checkbox"/>

Arch/Strut _____

Building was inspected on 22/11/2012

Table IEP-2 Initial Evaluation Procedure – Step 2

(Refer Table IEP - 1 for Step 1; Table IEP - 3 for Step 3, Table IEP - 4 for Steps 4, 5 and 6)



Building Name:	Garage - Rawhiti Golf Course (PRK_2004_BLDG_017 EQ2)	Ref.	ZB01276.187
Location:	Bowhill Rd 35 - 37	By	NLC
Direction Considered:	Longitudinal & Transverse	Date	23/05/2013
(Choose worse case if clear at start. Complete IEP-2 and IEP-3 for each if in doubt)			

Step 2 - Determination of (%NBS)b

2.1 Determine nominal (%NBS) = (%NBS)nom

Pre 1935
 1935-1965
 1965-1976 Seismic Zone; A
 B
 C
 1976-1992 Seismic Zone; A
 B
 C
 1992-2004

<input type="radio"/>	See also notes 1, 3
<input type="radio"/>	
<input type="radio"/>	
<input type="radio"/>	
<input type="radio"/>	See also note 2
<input type="radio"/>	
<input checked="" type="radio"/>	
<input type="radio"/>	
<input type="radio"/>	

b) Soil Type

From NZS1170.5:2004, Cl 3.1.3
 A or B Rock
 C Shallow Soil
 D Soft Soil
 E Very Soft Soil

<input type="radio"/>
<input type="radio"/>
<input checked="" type="radio"/>
<input type="radio"/>

From NZS4203:1992, Cl 4.6.2.2
 (for 1992 to 2004 only and only if known)
 a) Rigid
 b) Intermediate

<input checked="" type="radio"/>	N-A
<input type="radio"/>	

c) Estimate Period, T

building Ht = **3.4** meters

Can use following:

$T = 0.09h_n^{0.75}$ for moment-resisting concrete frames
 $T = 0.14h_n^{0.75}$ for moment-resisting steel frames
 $T = 0.08h_n^{0.75}$ for eccentrically braced steel frames
 $T = 0.06h_n^{0.75}$ for all other frame structures
 $T = 0.09h_n^{0.75}/A_c^{0.5}$ for concrete shear walls
 $T \leq 0.4\text{sec}$ for masonry shear walls

Longitudinal	Transverse
<input type="radio"/> MRCF	<input type="radio"/> MRCF
<input type="radio"/> MRSF	<input type="radio"/> MRSF
<input type="radio"/> EBSF	<input type="radio"/> EBSF
<input type="radio"/> Others	<input type="radio"/> Others
<input type="radio"/> CSW	<input type="radio"/> CSW
<input checked="" type="radio"/> MSW	<input checked="" type="radio"/> MSW

Where h_n = height in m from the base of the structure to the uppermost seismic weight or mass.
 $A_c = \sum A_i(0.2 + L_{wi}/h_n)^2$
 A_i = cross-sectional shear area of shear wall i in the first storey of the building, in m^2
 L_{wi} = length of shear wall i in the first storey in the direction parallel to the applied forces, in m
 with the restriction that L_{wi}/h_n shall not exceed 0.9

Longitudinal	Transverse
0.4	0.4

Seconds

d) (%NBS)nom determined from Figure 3.3

Longitudinal	16.5	(%NBS)nom
Transverse	16.5	(%NBS)nom

Note 1: For buildings designed prior to 1965 and known to be designed as public buildings in accordance with the code of the time, multiply (%NBS)nom by 1.25. Factor 1

For buildings designed 1965 - 1976 and known to be designed as public buildings in accordance with the code of the time, multiply (%NBS)nom by 1.33 - Zone A or 1.2 - Zone B. Factor 1

Note 2: For reinforced concrete buildings designed between 1976 -1984 (%NBS)nom by 1.2. Factor 1

Note 3: For buildings designed prior to 1935 multiply (%NBS)nom by 0.8 except for Wellington where the factor may be taken as 1. Factor 1

Longitudinal	16.5	(%NBS)nom
Transverse	16.5	(%NBS)nom

Continued over page

Building Name:	Garage - Rawhiti Golf Course (PRK_2004_BLDG_017 EQ2)	Ref.	ZB01276.187
Location:	Bowhill Rd 35 - 37	By	NLC
Direction Considered:	Longitudinal & Transverse	Date	23/05/2013
(Choose worse case if clear at start. Complete IEP-2 and IEP-3 for each if in doubt)			

2.2 Near Fault Scaling Factor, Factor A
If T < 1.5sec, Factor A = 1

a) Near Fault Factor, N(T,D) 1
(from NZS1170.5:2004, Cl 3.1.6)

b) Near Fault Scaling Factor = 1/N(T,D)

Factor A	1.00
----------	------

2.3 Hazard Scaling Factor, Factor B

Select Location ▼

a) Hazard Factor, Z, for site
(from NZS1170.5:2004, Table 3.3)

Z =	0.3		
Z 1992 =	0.8	Auckland 0.6	Palm Nth 1.2
		Wellington 1.2	Dunedin 0.6
		Christchurch 0.8	Hamilton 0.67

b) Hazard Scaling Factor
For pre 1992 = 1/Z
For 1992 onwards = Z 1992/Z
(Where Z 1992 is the NZS4203:1992 Zone Factor from accompanying Figure 3.5(b))

Factor B	3.33
----------	------

2.4 Return Period Scaling Factor, Factor C

a) Building Importance Level ▼
(from NZS1170.0:2004, Table 3.1 and 3.2)

b) Return Period Scaling Factor from accompanying Table 3.1

Factor C	1.00
----------	------

2.5 Ductility Scaling Factor, D

a) Assessed Ductility of Existing Structure, μ
(shall be less than maximum given in accompanying Table 3.2)

Longitudinal	1	μ Maximum = 6
Transverse	1	μ Maximum = 6

b) Ductility Scaling Factor
For pre 1976 = k_{μ}
For 1976 onwards = 1
(where k_{μ} is NZS1170.5:2005 Ductility Factor, from accompanying Table 3.3)

Longitudinal	Factor D	1.00
Transverse	Factor D	1.00

2.6 Structural Performance Scaling Factor, Factor E

Select Material of Lateral Load Resisting System

Longitudinal ▼
Transverse ▼

a) Structural Performance Factor, S_p
from accompanying Figure 3.4

Longitudinal	S_p	1.00
Transverse	S_p	1.00

b) Structural Performance Scaling Factor

Longitudinal	$1/S_p$	Factor E	1.00
Transverse	$1/S_p$	Factor E	1.00

2.7 Baseline %NBS for Building, (%NBS)_b
(equals (%NSB)_{nom} x A x B x C x D x E)

Longitudinal	55.0	(%NBS) _b
Transverse	55.0	(%NBS) _b

Table IEP-3 Initial Evaluation Procedure – Step 3

(Refer Table IEP - 1 for Step 1; Table IEP - 2 for Step 2, Table IEP - 4 for Steps 4, 5 and 6)

Building Name: <u>Garage - Rawhiti Golf Course (PRK_2004_BLDG_017 EQ2)</u>	Ref. <u>ZB01276.187</u>
Location: <u>Bowhill Rd 35 - 37</u>	By <u>NLC</u>
Direction Considered: a) Longitudinal	Date <u>23/05/2013</u>
(Choose worse case if clear at start. Complete IEP-2 and IEP-3 for each if in doubt)	

Step 3 - Assessment of Performance Achievement Ratio (PAR)

(Refer Appendix B - Section B3.2)

Critical Structural Weakness

Effect on Structural Performance

(Choose a value - Do not interpolate)

Building

Score

3.1 Plan Irregularity

Effect on Structural Performance
Comment

Severe	Significant	Insignificant
<input type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>

Factor A

3.2 Vertical Irregularity

Effect on Structural Performance
Comment

Severe	Significant	Insignificant
<input type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>

Factor B

3.3 Short Columns

Effect on Structural Performance
Comment

Severe	Significant	Insignificant
<input type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>

Factor C

3.4 Pounding Potential

(Estimate D1 and D2 and set D = the lower of the two, or =1.0 if no potential for pounding)

a) Factor D1: - Pounding Effect

Select appropriate value from Table

Note:
Values given assume the building has a frame structure. For stiff buildings (eg with shear walls), the effect of pounding may be reduced by taking the co-efficient to the right of the value applicable to frame buildings.

Factor D1

Table for Selection of Factor D1	Separation	Factor D1		
		Severe	Significant	Insignificant
		0<Sep<.005H	.005<Sep<.01H	Sep>.01H
Alignment of Floors within 20% of Storey Height		<input type="radio"/> 0.7	<input type="radio"/> 0.8	<input checked="" type="radio"/> 1
Alignment of Floors not within 20% of Storey Height		<input type="radio"/> 0.4	<input type="radio"/> 0.7	<input type="radio"/> 0.8

b) Factor D2: - Height Difference Effect

Select appropriate value from Table

Factor D2

Table for Selection of Factor D2	Separation	Factor D2		
		Severe	Significant	Insignificant
		0<Sep<.005H	.005<Sep<.01H	Sep>.01H
Height Difference > 4 Storeys		<input type="radio"/> 0.4	<input type="radio"/> 0.7	<input checked="" type="radio"/> 1
Height Difference 2 to 4 Storeys		<input type="radio"/> 0.7	<input type="radio"/> 0.9	<input type="radio"/> 1
Height Difference < 2 Storeys		<input type="radio"/> 1	<input type="radio"/> 1	<input type="radio"/> 1

Factor D

(Set D = lesser of D1 and D2 or..
set D = 1.0 if no prospect of pounding)

3.5 Site Characteristics - (Stability, landslide threat, liquefaction etc)

Effect on Structural Performance

Severe	Significant	Insignificant
<input type="radio"/> 0.5	<input type="radio"/> 0.7	<input checked="" type="radio"/> 1

Factor E

3.6 Other Factors

For < 3 storeys - Maximum value 2.5,

otherwise - Maximum value 1.5. No minimum.

Factor F

Record rationale for choice of Factor F:

3.7 Performance Achievement Ratio (PAR)
(equals A x B x C x D x E x F)

PAR

Building Name:	Garage - Rawhiti Golf Course (PRK_2004_BLDG_017 EQ2)	Ref.	ZB01276.187
Location:	Bowhill Rd 35 - 37	By	NLC
Direction Considered:	b) Transverse	Date	23/05/2013
(Choose worse case if clear at start. Complete IEP-2 and IEP-3 for each if in doubt)			

Step 3 - Assessment of Performance Achievement Ratio (PAR)
(Refer Appendix B - Section B3.2)

Critical Structural Weakness

Effect on Structural Performance
(Choose a value - Do not interpolate)

Building Score

3.1 Plan Irregularity

Effect on Structural Performance

Comment

Severe	Significant	Insignificant
<input type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>

Factor A

3.2 Vertical Irregularity

Effect on Structural Performance

Comment

Severe	Significant	Insignificant
<input type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>

Factor B

3.3 Short Columns

Effect on Structural Performance

Comment

Severe	Significant	Insignificant
<input type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>

Factor C

3.4 Pounding Potential

(Estimate D1 and D2 and set D = the lower of the two, or =1.0 if no potential for pounding)

a) Factor D1: - Pounding Effect

Select appropriate value from Table

Note:

Values given assume the building has a frame structure. For stiff buildings (eg with shear walls), the effect of pounding may be reduced by taking the co-efficient to the right of the value applicable to frame buildings.

Factor D1

Table for Selection of Factor D1

	Severe	Significant	Insignificant
Separation	0<Sep<.005H	.005<Sep<.01H	Sep>.01H
Alignment of Floors within 20% of Storey Height	<input type="radio"/> 0.7	<input type="radio"/> 0.8	<input checked="" type="radio"/> 1
Alignment of Floors not within 20% of Storey Height	<input type="radio"/> 0.4	<input type="radio"/> 0.7	<input type="radio"/> 0.8

b) Factor D2: - Height Difference Effect

Select appropriate value from Table

Factor D2

Table for Selection of Factor D2

	Severe	Significant	Insignificant
Separation	0<Sep<.005H	.005<Sep<.01H	Sep>.01H
Height Difference > 4 Storeys	<input type="radio"/> 0.4	<input type="radio"/> 0.7	<input type="radio"/> 1
Height Difference 2 to 4 Storeys	<input type="radio"/> 0.7	<input type="radio"/> 0.9	<input type="radio"/> 1
Height Difference < 2 Storeys	<input type="radio"/> 1	<input type="radio"/> 1	<input checked="" type="radio"/> 1

Factor D

(Set D = lesser of D1 and D2 or..
set D = 1.0 if no prospect of pounding)

3.5 Site Characteristics - (Stability, landslide threat, liquefaction etc)

Effect on Structural Performance

Severe	Significant	Insignificant
<input type="radio"/> 0.5	<input type="radio"/> 0.7	<input checked="" type="radio"/> 1

Factor E

3.6 Other Factors

For < 3 storeys - Maximum value 2.5,

otherwise - Maximum value 1.5. No minimum.

Factor F

Record rationale for choice of Factor F:

3.7 Performance Achievement Ratio (PAR)
(equals A x B x C x D x E x F)

PAR

Building Name:	Garage - Rawhiti Golf Course (PRK_2004_BLDG_017 EQ2)	Ref.	ZB01276.187
Location:	Bowhill Rd 35 - 37	By	NLC
Direction Considered:	Longitudinal & Transverse	Date	23/05/2013
<small>(Choose worse case if clear at start. Complete IEP-2 and IEP-3 for each if in doubt)</small>			

Step 4 - Percentage of New Building Standard (%NBS)

	Longitudinal	Transverse
4.1 Assessed Baseline (%NBS)_b (from Table IEP - 1)	55	55
4.2 Performance Achievement Ratio (PAR) (from Table IEP - 2)	1.00	1.00
4.3 PAR x Baseline (%NBS)_b	55	55
4.4 Percentage New Building Standard (%NBS) (Use lower of two values from Step 4.3)		55

Step 5 - Potentially Earthquake Prone?
(Mark as appropriate)

%NBS ≤ 33 NO

Step 6 - Potentially Earthquake Risk?

%NBS < 67 YES

Step 7 - Provisional Grading for Seismic Risk based on IEP

Seismic Grade C

Evaluation Confirmed by



Signature

Nick Calvert

Name

242062

CPEng. No

Relationship between Seismic Grade and % NBS :

Grade:	A+	A	B	C	D	E
%NBS:	> 100	100 to 80	80 to 67	67 to 33	33 to 20	< 20



13. Appendix 3 – CERA Standardised Report Form

Location		Building Name: <input type="text" value="Garage - Rawhiti Golf Course"/>	Reviewer: <input type="text" value="Nick Calvert"/>
	Unit No: <input type="text" value="Street"/>	CPEng No: <input type="text" value="242062"/>	
Building Address: <input type="text" value="35-37 Bowhill Road"/>		Company: <input type="text" value="Sinclair Knight Merz"/>	
Legal Description: <input type="text"/>		Company project number: <input type="text" value="ZB01276.187"/>	
		Company phone number: <input type="text" value="03 940 4900"/>	
	Degrees Min Sec	Date of submission: <input type="text" value="24-May"/>	
GPS south: <input type="text"/>		Inspection Date: <input type="text" value="22/11/2012"/>	
GPS east: <input type="text"/>		Revision: <input type="text" value="B"/>	
Building Unique Identifier (CCC): <input type="text" value="PRK 2004 BLDG 017"/>		Is there a full report with this summary? <input type="text" value="yes"/>	

Site		Max retaining height (m): <input type="text" value="0"/>
Site slope: <input type="text" value="flat"/>		Soil Profile (if available): <input type="text"/>
Soil type: <input type="text" value="mixed"/>		
Site Class (to NZS1170.5): <input type="text" value="D"/>		if Ground improvement on site, describe: <input type="text"/>
Proximity to waterway (m, if <100m): <input type="text"/>		
Proximity to cliff top (m, if <100m): <input type="text"/>		Approx site elevation (m): <input type="text" value="0.00"/>
Proximity to cliff base (m, if <100m): <input type="text"/>		

Building		single storey = 1	Ground floor elevation (Absolute) (m): <input type="text" value="0.00"/>
No. of storeys above ground: <input type="text" value="1"/>		Ground floor elevation above ground (m): <input type="text" value="0.00"/>	
Ground floor split? <input type="text" value="no"/>			
Storeys below ground: <input type="text" value="0"/>			
Foundation type: <input type="text" value="mat slab"/>		if Foundation type is other, describe: <input type="text"/>	
Building height (m): <input type="text" value="3.30"/>		height from ground to level of uppermost seismic mass (for IEP only) (m): <input type="text" value="3.3"/>	
Floor footprint area (approx): <input type="text" value="250"/>			
Age of Building (years): <input type="text" value="30"/>		Date of design: <input type="text" value="1976-1992"/>	
Strengthening present? <input type="text" value="no"/>		If so, when (year)? <input type="text"/>	
Use (ground floor): <input type="text" value="other (specify)"/>		And what load level (%g)? <input type="text"/>	
Use (upper floors): <input type="text"/>		Brief strengthening description: <input type="text"/>	
Use notes (if required): <input type="text" value="garage, office, toilet, storage"/>			
Importance level (to NZS1170.5): <input type="text" value="IL2"/>			

Gravity Structure		
Gravity System: <input type="text" value="load bearing walls"/>		
Roof: <input type="text" value="timber framed"/>		
Floors: <input type="text" value="concrete flat slab"/>		
Beams: <input type="text" value="steel non-composite"/>		
Columns: <input type="text" value="structural steel"/>		
Walls: <input type="text" value="partially filled concrete masonry"/>		
		approx 180UB rafters where portal frames are present, else purlins sit on the masonry walls. 190 x 45 purlins. 90 x 45 noggling, corrugate metal slab thickness (mm) approx 200mm thick beam and connector type UB steel portal frame typical dimensions (mm x mm) 100 SHS thickness (mm) 190

Lateral load resisting structure			
Lateral system along: <input type="text" value="partially filled CMU"/>		Note: Define along and across in detailed report!	note total length of wall at ground (m): <input type="text" value="31"/>
Ductility assumed, μ : <input type="text" value="1.00"/>		0.40 from parameters in sheet	wall thickness (m): <input type="text" value="0.19"/>
Period along: <input type="text" value="0.40"/>			estimate or calculation? <input type="text" value="estimated"/>
Total deflection (ULS) (mm): <input type="text" value="5"/>			estimate or calculation? <input type="text" value="estimated"/>
maximum interstorey deflection (ULS) (mm): <input type="text"/>			estimate or calculation? <input type="text"/>
Lateral system across: <input type="text" value="partially filled CMU"/>			note total length of wall at ground (m): <input type="text" value="37"/>
Ductility assumed, μ : <input type="text" value="1.00"/>		0.40 from parameters in sheet	wall thickness (m): <input type="text" value="0.19"/>
Period across: <input type="text" value="0.40"/>			estimate or calculation? <input type="text" value="estimated"/>
Total deflection (ULS) (mm): <input type="text" value="5"/>			estimate or calculation? <input type="text" value="estimated"/>
maximum interstorey deflection (ULS) (mm): <input type="text"/>			estimate or calculation? <input type="text"/>

Separations:		
north (mm): <input type="text"/>		leave blank if not relevant
east (mm): <input type="text"/>		
south (mm): <input type="text"/>		
west (mm): <input type="text"/>		

Non-structural elements		
Stairs: <input type="text"/>		
Wall cladding: <input type="text" value="exposed structure"/>		describe: <input type="text" value="exposed masonry"/>
Roof Cladding: <input type="text" value="Metal"/>		describe: <input type="text" value="assume 0.55mm thick roof cladding"/>
Glazing: <input type="text" value="timber frames"/>		
Ceilings: <input type="text" value="none"/>		
Services(list): <input type="text"/>		<input type="text" value="garage has no ceiling, office has gqb"/>

Available documentation		
Architectural: <input type="text" value="none"/>		original designer name/date: <input type="text"/>
Structural: <input type="text" value="none"/>		original designer name/date: <input type="text"/>
Mechanical: <input type="text" value="none"/>		original designer name/date: <input type="text"/>
Electrical: <input type="text" value="none"/>		original designer name/date: <input type="text"/>
Geotech report: <input type="text" value="none"/>		original designer name/date: <input type="text"/>

Damage		
Site: (refer DEE Table 4-2)	Site performance: <input type="text"/>	Describe damage: <input type="text"/>
Settlement: <input type="text" value="none observed"/>		notes (if applicable): <input type="text"/>
Differential settlement: <input type="text" value="none observed"/>		notes (if applicable): <input type="text"/>
Liquefaction: <input type="text" value="none apparent"/>		notes (if applicable): <input type="text"/>
Lateral Spread: <input type="text" value="none apparent"/>		notes (if applicable): <input type="text"/>
Differential lateral spread: <input type="text" value="none apparent"/>		notes (if applicable): <input type="text"/>
Ground cracks: <input type="text" value="none apparent"/>		notes (if applicable): <input type="text"/>
Damage to area: <input type="text" value="none apparent"/>		notes (if applicable): <input type="text"/>

Building:		
Current Placard Status: <input type="text" value="green"/>		
Along	Damage ratio: <input type="text" value="0%"/>	Describe how damage ratio arrived at: <input type="text" value="damage observed will not affect %NBS"/>
Describe (summary): <input type="text"/>		
Across	Damage ratio: <input type="text" value="0%"/>	$Damage_Ratio = \frac{(\% NBS (before) - \% NBS (after))}{\% NBS (before)}$
Describe (summary): <input type="text"/>		
Diaphragms	Damage?: <input type="text" value="no"/>	Describe: <input type="text"/>
CSWs:	Damage?: <input type="text" value="no"/>	Describe: <input type="text"/>
Pounding:	Damage?: <input type="text" value="no"/>	Describe: <input type="text"/>
Non-structural:	Damage?: <input type="text" value="no"/>	Describe: <input type="text"/>

Recommendations		
Level of repair/strengthening required: <input type="text" value="minor non-structural"/>		Describe: <input type="text" value="Mortar to be ground out, repointed and made good to match existing"/>
Building Consent required: <input type="text" value="no"/>		Describe: <input type="text"/>
Interim occupancy recommendations: <input type="text" value="full occupancy"/>		Describe: <input type="text"/>
Along	Assessed %NBS before: <input type="text" value="55%"/>	%NBS from IEP below
	Assessed %NBS after: <input type="text" value="55%"/>	
Across	Assessed %NBS before: <input type="text" value="55%"/>	%NBS from IEP below
	Assessed %NBS after: <input type="text" value="55%"/>	
		If IEP not used, please detail assessment methodology: <input type="text" value="Qualitative Assessment carried out, this includes the NZSEE IEP - refer to SKM report"/>