



CLIENTS | PEOPLE | PERFORMANCE

Toilet Rawhiti Golf Course – 6th Fairway
PRK 2004 BLDG 016
Detailed Engineering Evaluation
Qualitative Report
Version Final

35 – 37 Bowhill Road



**Toilet Rawhiti Golf Course – 6th Fairway
PRK 2004 BLDG 016**

Detailed Engineering Evaluation
Qualitative Report
Version Final

35 – 37 Bowhill Road

Christchurch City Council

Prepared By
Paul Clarke

Reviewed By
Alex Baylis

Date
17th May 2013



Contents

Qualitative Report Summary	i
1. Background	1
2. Compliance	2
2.1 Canterbury Earthquake Recovery Authority (CERA)	2
2.2 Building Act	3
2.3 Christchurch City Council Policy	4
2.4 Building Code	4
3. Earthquake Resistance Standards	5
4. Building Description	7
4.1 General	7
4.2 Gravity Load Resisting System	8
4.3 Lateral Load Resisting System	8
5. Assessment	9
6. Damage Assessment	10
6.1 Surrounding Buildings	10
6.2 Residual Displacements and General Observations	10
6.3 Ground Damage	10
7. Critical Structural Weakness	11
7.1 Short Columns	11
7.2 Lift Shaft	11
7.3 Roof	11
7.4 Staircases	11
7.5 Site Characteristics	11
8. Geotechnical Consideration	12
8.1 Site Description	12
8.2 Published Information on Ground Conditions	12
8.3 Seismicity	13
8.4 Slope Failure and/or Rockfall Potential	14



8.5	Liquefaction Potential	14
8.6	Conclusions & Recommendations	14
9.	Survey	16
10.	Initial Capacity Assessment	17
10.1	% NBS Assessment	17
10.2	Seismic Parameters	17
10.3	Expected Structural Ductility Factor	17
10.4	Discussion of Results	17
10.5	Occupancy	18
11.	Initial Conclusions	19
12.	Recommendations	20
13.	Limitations	21
13.1	General	21
13.2	Geotechnical Limitations	21

Table Index

Table 1	%NBS compared to relative risk of failure	6
Table 2	ECan Borehole Summary	12
Table 3	Summary of Known Active Faults	14

Figure Index

Figure 1	NZSEE Risk Classifications Extracted from table 2.2 of the NZSEE 2006 AISPBE	5
Figure 2	Plan Sketch Showing Key Structural Elements	7
Figure 3	Post February 2011 Earthquake Aerial Photography	13

Appendices

- A Photographs
- B Existing Drawings / Sketches
- C CERA Building Evaluation Form



Qualitative Report Summary

Toilets Rawhiti Golf Course – 6th Fairway

PRK 2004 BLDG 016

Detailed Engineering Evaluation

Qualitative Report - SUMMARY

Version Final

35 – 37 Bowhill Road

Background

This is a summary of the Qualitative report for the building structure, and is based in part on the Detailed Engineering Evaluation Procedure document (draft) issued by the Structural Advisory Group on 19 July 2011 and visual inspections on 18th June 2012.

Building Description

The approximately 65 degree duo-pitch roof is formed by corrugate sheet on timber purlin and timber truss. Walls are probably partially filled 15 series masonry with a timber column also supporting a portion of the roof. Ground slab most likely doubles as raft foundation, on grade.

Key Damage Observed

No damage was observed to the structure.

Critical Structural Weaknesses

No critical structural weaknesses were identified in the structure.

Indicative Building Strength (from IEP and CSW assessment)

Based on the information available, and using the NZSEE Initial Evaluation Procedure, the original capacity of the building has been assessed to be in the order of 59% NBS and post-earthquake capacity also in the order of 59% NBS. As none were identified, there is no reduction in %NBS due to critical structural weaknesses.

The building has been assessed to have a seismic capacity in the order of 59% NBS and is therefore potentially Earthquake Risk but not potentially Earthquake Prone.

Recommendations

The building has been assessed as not being potentially Earthquake Prone and as a result, the Toilet can remain in use.



1. Background

GHD has been engaged by the Christchurch City Council (CCC) to undertake a detailed engineering evaluation of the Toilet Rawhiti Golf Course – 6th Fairway.

This report is a Qualitative Assessment of the building structure, and is based in part on the Detailed Engineering Evaluation Procedure document (draft) issued by the Structural Advisory Group on 19 July 2011.

A qualitative assessment involves inspections of the building and a desktop review of existing structural and geotechnical information, including existing drawings and calculations, if available.

The purpose of the assessment is to determine the likely building performance and damage patterns, to identify any potential critical structural weaknesses or collapse hazards, and to make an initial assessment of the likely building strength in terms of percentage of new building standard (%NBS).

At the time of this report, no intrusive site investigation, detailed analysis, or modelling of the building structure had been carried out. Construction drawings were made available, and these have been considered in our evaluation of the building. The building description below is based on a review of the drawings and our visual inspections.



2. Compliance

This section contains a brief summary of the requirements of the various statutes and authorities that control activities in relation to buildings in Christchurch at present.

2.1 Canterbury Earthquake Recovery Authority (CERA)

CERA was established on 28 March 2011 to take control of the recovery of Christchurch using powers established by the Canterbury Earthquake Recovery Act enacted on 18 April 2011. This act gives the Chief Executive Officer of CERA wide powers in relation to building safety, demolition and repair. Two relevant sections are:

Section 38 – Works

This section outlines a process in which the chief executive can give notice that a building is to be demolished and if the owner does not carry out the demolition, the chief executive can commission the demolition and recover the costs from the owner or by placing a charge on the owners' land.

Section 51 – Requiring Structural Survey

This section enables the chief executive to require a building owner, insurer or mortgagee carry out a full structural survey before the building is re-occupied.

We understand that CERA will require a detailed engineering evaluation to be carried out for all buildings (other than those exempt from the Earthquake Prone Building definition in the Building Act). It is anticipated that CERA will adopt the Detailed Engineering Evaluation Procedure document (draft) issued by the Structural Advisory Group on 19 July 2011. This document sets out a methodology for both qualitative and quantitative assessments.

The qualitative assessment is a desk-top and site inspection assessment. It is based on a thorough visual inspection of the building coupled with a review of available documentation such as drawings and specifications. The quantitative assessment involves analytical calculation of the buildings strength and may require non-destructive or destructive material testing, geotechnical testing and intrusive investigation.

It is anticipated that factors determining the extent of evaluation and strengthening level required will include:

- ▶ The importance level and occupancy of the building
- ▶ The placard status and amount of damage
- ▶ The age and structural type of the building
- ▶ Consideration of any critical structural weaknesses
- ▶ The extent of any earthquake damage



2.2 Building Act

Several sections of the Building Act are relevant when considering structural requirements:

Section 112 – Alterations

This section requires that an existing building complies with the relevant sections of the Building Code to at least the extent that it did prior to any alteration. This effectively means that a building cannot be weakened as a result of an alteration (including partial demolition).

Section 115 – Change of Use

This section requires that the territorial authority (in this case Christchurch City Council (CCC)) be satisfied that the building with a new use complies with the relevant sections of the Building Code 'as near as is reasonably practicable'. Regarding seismic capacity 'as near as reasonably practicable' has previously been interpreted by CCC as achieving a minimum of 67% NBS however where practical achieving 100% NBS is desirable. The New Zealand Society for Earthquake Engineering (NZSEE) recommend a minimum of 67% NBS.

2.2.1 Section 121 – Dangerous Buildings

The definition of dangerous building in the Act was extended by the Canterbury Earthquake (Building Act) Order 2010, and it now defines a building as dangerous if:

- ▶ In the ordinary course of events (excluding the occurrence of an earthquake), the building is likely to cause injury or death or damage to other property; or
- ▶ In the event of fire, injury or death to any persons in the building or on other property is likely because of fire hazard or the occupancy of the building; or
- ▶ There is a risk that the building could collapse or otherwise cause injury or death as a result of earthquake shaking that is less than a 'moderate earthquake' (refer to Section 122 below); or
- ▶ There is a risk that that other property could collapse or otherwise cause injury or death; or
- ▶ A territorial authority has not been able to undertake an inspection to determine whether the building is dangerous.

Section 122 – Earthquake Prone Buildings

This section defines a building as earthquake prone if its ultimate capacity would be exceeded in a 'moderate earthquake' and it would be likely to collapse causing injury or death, or damage to other property. A moderate earthquake is defined by the building regulations as one that would generate ground shaking 33% of the shaking used to design an equivalent new building.

Section 124 – Powers of Territorial Authorities

This section gives the territorial authority the power to require strengthening work within specified timeframes or to close and prevent occupancy to any building defined as dangerous or earthquake prone.

Section 131 – Earthquake Prone Building Policy

This section requires the territorial authority to adopt a specific policy for earthquake prone, dangerous and insanitary buildings.



2.3 Christchurch City Council Policy

Christchurch City Council adopted their Earthquake Prone, Dangerous and Insanitary Building Policy in 2006. This policy was amended immediately following the Darfield Earthquake of the 4th September 2010.

The 2010 amendment includes the following:

- ▶ A process for identifying, categorising and prioritising Earthquake Prone Buildings, commencing on 1 July 2012;
- ▶ A strengthening target level of 67% of a new building for buildings that are Earthquake Prone;
- ▶ A timeframe of 15-30 years for Earthquake Prone Buildings to be strengthened; and,
- ▶ Repair works for buildings damaged by earthquakes will be required to comply with the above.

The council has stated their willingness to consider retrofit proposals on a case by case basis, considering the economic impact of such a retrofit.

We anticipate that any building with a capacity of less than 33% NBS (including consideration of critical structural weaknesses) will need to be strengthened to a target of 67% NBS of new building standard as recommended by the Policy.

If strengthening works are undertaken, a building consent will be required. A requirement of the consent will require upgrade of the building to comply 'as near as is reasonably practicable' with:

- ▶ The accessibility requirements of the Building Code.
- ▶ The fire requirements of the Building Code. This is likely to require a fire report to be submitted with the building consent application.

2.4 Building Code

The building code outlines performance standards for buildings and the Building Act requires that all new buildings comply with this code. Compliance Documents published by The Department of Building and Housing can be used to demonstrate compliance with the Building Code.

After the February Earthquake, on 19 May 2011, Compliance Document B1: Structure was amended to include increased seismic design requirements for Canterbury as follows:

- ▶ Hazard Factor increased from 0.22 to 0.3 (36% increase in the basic seismic design load)
- ▶ Serviceability Return Period Factor increased from 0.25 to 0.33 (80% increase in the serviceability design loads when combined with the Hazard Factor increase)

The increase in the above factors has resulted in a reduction in the level of compliance of an existing building relative to a new building despite the capacity of the existing building not changing.



3. Earthquake Resistance Standards

For this assessment, the building's earthquake resistance is compared with the current New Zealand Building Code requirements for a new building constructed on the site. This is expressed as a percentage of new building standard (%NBS). The new building standard load requirements have been determined in accordance with the current earthquake loading standard (NZS 1170.5:2004 Structural design actions - Earthquake actions - New Zealand).

The likely capacity of this building has been derived in accordance with the New Zealand Society for Earthquake Engineering (NZSEE) guidelines 'Assessment and Improvement of the Structural Performance of Buildings in Earthquakes' (AISPBE), 2006. These guidelines provide an Initial Evaluation Procedure that assesses a buildings capacity based on a comparison of loading codes from when the building was designed and currently. It is a quick high-level procedure that can be used when undertaking a Qualitative analysis of a building. The guidelines also provide guidance on calculating a modified Ultimate Limit State capacity of the building which is much more accurate and can be used when undertaking a Quantitative analysis.

The New Zealand Society for Earthquake Engineering has proposed a way for classifying earthquake risk for existing buildings in terms of %NBS and this is shown in Figure 1 below.

Description	Grade	Risk	%NBS	Existing Building Structural Performance	Improvement of Structural Performance	
					Legal Requirement	NZSEE Recommendation
Low Risk Building	A or B	Low	Above 67	Acceptable (improvement may be desirable)	The Building Act sets no required level of structural improvement (unless change in use) This is for each TA to decide. Improvement is not limited to 34%NBS.	100%NBS desirable. Improvement should achieve at least 67%NBS
Moderate Risk Building	B or C	Moderate	34 to 66	Acceptable legally. Improvement recommended		Not recommended. Acceptable only in exceptional circumstances
High Risk Building	D or E	High	33 or lower	Unacceptable (Improvement)	Unacceptable	Unacceptable

Figure 1 NZSEE Risk Classifications Extracted from table 2.2 of the NZSEE 2006 AISPBE

Table 1 compares the percentage NBS to the relative risk of the building failing in a seismic event with a 10% risk of exceedance in 50 years (i.e. 0.2% in the next year). It is noted that the current seismic risk in Christchurch results in a 6% risk of exceedance in the next year.



Percentage of New Building Standard (%NBS)	Relative Risk (Approximate)
>100	<1 time
80-100	1-2 times
67-80	2-5 times
33-67	5-10 times
20-33	10-25 times
<20	>25 times

Table 1 %NBS compared to relative risk of failure

4. Building Description

4.1 General

The building is located at 35 – 37 Bowhill Road, New Brighton. The building's construction date is estimated as 1980's and the buildings sole use is a public toilet.

The approximately 65 degree duo-pitch roof is formed by corrugate sheet on timber purlin and timber truss. Walls are probably partially filled 15 series masonry with a timber column also supporting a portion of the roof. Ground slab most likely doubles as raft foundation, on grade.

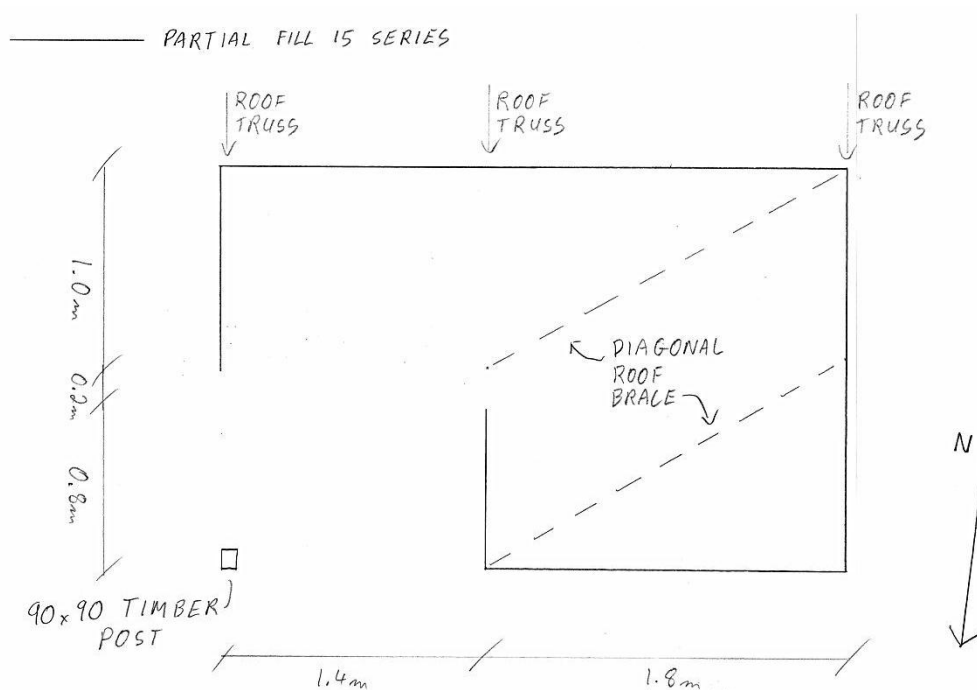


Figure 2 Plan Sketch Showing Key Structural Elements

The building is approximately 3.2m in length by 2m in width with a height of 3.6m. The nearest building is residential housing located over 100m to the north. The flat site is 500m west of the coast and approximately 800m north of Avon River. The immediate vicinity of the toilet is a golf course, mainly open parkland with some large trees intermittently.

No plans were available for the structure.



4.2 Gravity Load Resisting System

Gravity roof loads are transferred through roof trusses to the masonry walls and a corner timber post. These elements transmit the loads to the slab on grade.

4.3 Lateral Load Resisting System

In the longitudinal direction(E-W), lateral roof loads are transferred via 2 diagonal braces in the roof plane to walls in the plane of loading, which in turn transfer these loads to the ground by panel action. In the transverse direction(N-S), lateral roof loads are transferred from the purlins to the roof trusses which in turn transfer the load to walls in the plane of loading. These walls resist these loads by panel action of the masonry and transfer the loads to the ground.



5. Assessment

An inspection of the building was undertaken on the 18th June 2012. Both the interior and exterior of the building were inspected.

The inspection consisted of scrutinising the building to determine the structural systems and likely behaviour of the building during an earthquake. The site was assessed for damage, including examination of the ground conditions, checking for damage in areas where damage would be expected for the type of structure and noting general damage observed throughout the building in both structural and non-structural elements.

The %NBS score determined for this building has been based on the IEP procedure described by the NZSEE and based on the information obtained from visual observation of the building and available drawings.



6. Damage Assessment

6.1 Surrounding Buildings

There are no buildings nearby.

6.2 Residual Displacements and General Observations

No residual displacements of the structure were noticed during our inspection of the building.

6.3 Ground Damage

There was no evidence of ground damage on the property or surrounding neighbours land.



7. Critical Structural Weakness

7.1 Short Columns

No short columns are present in the structure.

7.2 Lift Shaft

The building does not contain a lift shaft.

7.3 Roof

Roof bracing is present in the form of diagonal timber members.

7.4 Staircases

The building does not contain a staircase.

7.5 Site Characteristics

Presence of sands and silts allow for liquefaction potential though no liquefaction has been observed, this coupled with a minimal potential effect on structural performance due to structural type, dictates a 'insignificant' site characteristic in accordance with the NZSEE guidelines.



8. Geotechnical Consideration

8.1 Site Description

The three individual sites are situated within a recreational domain, within the suburb of New Brighton in eastern Christchurch. It is relatively flat at approximately 3m above mean sea level. It is situated 500 m from the coast line (Pegasus Bay), approximately 800 m north of the Avon River.

8.2 Published Information on Ground Conditions

8.2.1 Published Geology

The geological map of the area¹ indicates that the site is underlain by Holocene marine/estuarine soils of the Christchurch Formation, comprising dominantly of sand of fixed and semi-fixed dunes and beaches

8.2.2 Environment Canterbury Logs

Information from Environment Canterbury (ECan) indicates that ten boreholes are located within a 200m radius of the site (see Table 2). Of these boreholes, two of them had lithographic logs that indicate the area is typically clays and sand with some peat layers between 30 and 40m bgl. Varying amounts of gravel is also indicated to be present. Groundwater was encountered between 1.65 and 5.2 m bgl.

Table 2 ECan Borehole Summary

Bore Name	Log Depth	Groundwater	Distance from Site
M35/2388	84.7m	5.2m bgl	200 m
M35/2443	104.2m	3.66m bgl	200m

It should be noted that the boreholes were sunk for groundwater extraction and not for geotechnical purposes' therefore, the amount of material recovered and available for interpretation and recording will have been variable at best and may not be representative. The logs have been written by the well driller and not a geotechnical professional or to a standard. In addition strength data is not recorded.

8.2.3 EQC Geotechnical Investigations

The Earthquake Commission has not undertaken geotechnical testing within 500m of the subject site.

8.2.4 Land Zoning

Canterbury Earthquake Recovery Authority (CERA) has indicated the site is situated within the Green Zone, indicating that repair and rebuild may take place.

Land in the CERA green zone has been divided into three technical categories TC1 (grey), TC2 (yellow) and TC3 (blue). These categories describe how the land is expected to perform in future earthquakes.

¹ Brown, L. J. and Weeber, J.H. 1992: Geology of the Christchurch Urban Area. Institute of Geological and Nuclear Sciences 1:25,000 Geological Map 1. Lower Hutt. Institute of Geological and Nuclear Sciences Limited.

The site is classified as NA - Urban Nonresidential however, residential properties surrounding the site have been categorised TC2 (Yellow).

8.2.5 Post February Aerial Photography

Aerial photography taken following the 22 February 2011 earthquake shows no signs of liquefaction outside the building footprint or adjacent to the site, as shown in Figure 3.

Figure 3 Post February 2011 Earthquake Aerial Photography ²



8.2.6 Summary of Ground Conditions

From the information presented above, the ground conditions underlying the site are anticipated to comprise multiple strata of clay and sand with varying peat layers and gravel.

8.3 Seismicity

8.3.1 Nearby Faults

There are many faults in the Canterbury region, however only those considered most likely to have an adverse effect on the site are detailed below.

² Aerial Photography Supplied by Koordinates sourced from <http://koordinates.com/layer/3185-christchurch-post-earthquake-aerial-photos-24-feb-2011/>



Table 3 Summary of Known Active Faults³⁴

Known Active Fault	Distance from Site	Direction from Site	Max Likely Magnitude	Avg Recurrence Interval
Alpine Fault	130 km	NW	~8.3	~300 years
Greendale (2010) Fault	29 km	W	7.1	~15,000 years
Hope Fault	110 km	N	7.2~7.5	120~200 years
Kelly Fault	110 km	NW	7.2	~150 years
Porters Pass Fault	70 km	NW	7.0	~1100 years

Recent earthquakes since 04 September 2010 have identified the presence of a previously unmapped active fault system underneath the Canterbury Plains, extending beneath Christchurch City and the Port Hills. Research and published information on this system is in development and not generally available. Average recurrence intervals are yet to be estimated.

8.3.2 Ground Shaking Hazard

New Zealand Standard NZS 1170.5:2004 quantifies the Seismic Hazard factor for Christchurch as 0.30, being in a moderate to high earthquake zone. This value has been provisionally upgraded recently (from 0.22) to reflect the seismicity hazard observed in the earthquakes since 4 September 2010.

The recent seismic activity has produced earthquakes of Magnitude-6.3 with peak ground accelerations (PGA) up to twice the acceleration due to gravity (2g) in some parts of the city. This has resulted in widespread liquefaction throughout Christchurch.

8.4 Slope Failure and/or Rockfall Potential

Given the site's location in New Brighton, a flat suburb in eastern Christchurch, global slope instability is considered negligible. However, any localised retaining structures or embankments should be further investigated to determine the site-specific slope instability potential.

8.5 Liquefaction Potential

Due to the presence of marine and alluvial deposits, liquefaction is considered possible where sands and silts are present. However, evidence from the post-earthquake aerial photography shows no signs of liquefaction.

8.6 Conclusions & Recommendations

This assessment is based on a review of the geology and existing ground investigation information, and observations from the Christchurch earthquakes since 4 September 2010.

³ Stirling, M.W, McVerry, G.H, and Berryman K.R. (2002) A New Seismic Hazard Model for New Zealand, Bulletin of the Seismological Society of America, Vol. 92 No. 5, pp 1878-1903, June 2002.

⁴ GNS Active Faults Database



The site appears to be situated on stratified marine and alluvial deposits, comprising clay, sand and gravel. Associated with this, the site also has a low to moderate liquefaction potential, in particular where sands are present.

A soil class of **D** (in accordance with NZS 1170.5:2004) should be adopted for the site. Should a more comprehensive liquefaction and/or ground condition assessment be required, it is recommended that intrusive investigation be conducted. Specific testing details can be provided upon commission of the quantitative assessment phase.



9. Survey

No level or verticality surveys have been undertaken for this building at this stage as indicated by Christchurch City Council guidelines.



10. Initial Capacity Assessment

10.1 % NBS Assessment

The building has had its capacity assessed using the Initial Evaluation Procedure based on the information available. No capacity reduction due to Critical Structural Weaknesses was necessary as none were identified, hence the New Building Standard, irrespective of CSW consideration, is in the order of 59% NBS.

A further reduction of %NBS was not necessary as no structural damage was observed.

Following an IEP and damage assessment, the building has been assessed as achieving 59% New Building Standard (NBS). Under the New Zealand Society for Earthquake Engineering (NZSEE) guidelines the building is considered Earthquake Risk as it achieves greater than 33% and less than 67% NBS. These capacities are subject to confirmation by a more detailed quantitative analysis.

10.2 Seismic Parameters

The seismic design parameters based on current design requirements from NZS 1170:2002 and the NZBC clause B1 for this building are:

- ▶ Site soil class: D, NZS 1170.5:2004, Clause 3.1.3, Soft Soil
- ▶ Site hazard factor, $Z = 0.3$, NZBC, Clause B1 Structure, Amendment 11 effective from 1 August 2011
- ▶ Return period factor $R_u = 1.0$, NZS 1170.5:2004, Table 3.5, Importance level 2 structure with a 50 year design life.

An increased Z factor of 0.3 for Christchurch has been used in line with requirements from the Department of Building and Housing resulting in a reduced % NBS score.

10.3 Expected Structural Ductility Factor

A structural ductility factor of 1.25 has been assumed based on the concrete masonry wall system observed and the date of construction. The concrete masonry walls are expected to have nominal ductility as the masonry units are likely to be partially filled and lightly reinforced.

10.4 Discussion of Results

The results obtained from the initial IEP assessment are consistent with those expected for a building of this age and construction type with no CSWs present. Although the exact building construction date is unknown, it is estimated as 1980's and was likely designed to the loading standard current at the time, NZS 4203:1984. The design loads used in accordance with this standard are likely to have been less than those required by the current loading standard. When combined with the increase in the hazard factor for Christchurch to 0.3, it would be expected that the building would not achieve 100% NBS. Due to the absence of Critical Structural Weaknesses and structural damage it is reasonable to expect the building to be classified as not potentially Earthquake Prone.



10.5 Occupancy

The building does not pose an immediate risk to users and occupants as no critical structural weaknesses have been identified. The building has been assessed as not being potentially Earthquake Prone and consequently, can remain in use.



11. Initial Conclusions

The building has been assessed to have a seismic capacity in the order of 59% NBS and is therefore not potentially Earthquake Prone, though is still considered potentially Earthquake Risk.



12. Recommendations

The toilet has been assessed as not being potentially Earthquake Prone and consequently, can remain in use.

CCC are not required to undertake a detailed seismic assessment, however due to the relatively low score, GHD recommend a detailed seismic assessment is carried out.



13. Limitations

13.1 General

This report has been prepared subject to the following limitations:

- ▶ No intrusive structural investigations have been undertaken.
- ▶ No intrusive geotechnical investigations have been undertaken.
- ▶ No level or verticality surveys have been undertaken.
- ▶ No material testing has been undertaken.
- ▶ No calculations, other than those included as part of the IEP in the CERA Building Evaluation Report, have been undertaken. No modelling of the building for structural analysis purposes has been performed.

It is noted that this report has been prepared at the request of Christchurch City Council and is intended to be used for their purposes only. GHD accepts no responsibility for any other party or person who relies on the information contained in this report or a specific limitations section.

13.2 Geotechnical Limitations

This report presents the results of a geotechnical appraisal prepared for the purpose of this commission, and for prepared solely for the use of Christchurch City Council and their advisors. The data and advice provided herein relate only to the project and structures described herein and must be reviewed by a competent geotechnical engineer before being used for any other purpose. GHD Limited (GHD) accepts no responsibility for other use of the data.

The advice tendered in this report is based on a visual geotechnical appraisal. No subsurface investigations have been conducted. An assessment of the topographical land features have been made based on this information. It is emphasised that Geotechnical conditions may vary substantially across the site from where observations have been made. Subsurface conditions, including groundwater levels can change in a limited distance or time. In evaluation of this report cognisance should be taken of the limitations of this type of investigation.

An understanding of the geotechnical site conditions depends on the integration of many pieces of information, some regional, some site specific, some structure specific and some experienced based. Hence this report should not be altered, amended or abbreviated, issued in part and issued incomplete in any way without prior checking and approval by GHD. GHD accepts no responsibility for any circumstances, which arise from the issue of the report, which have been modified in any way as outlined above.



Appendix A

Photographs



Photograph 1 North elevation.



Photograph 2 View of the toilet from the south.




Photograph 3 Roof structure showing truss, purlins and diagonal brace.



Photograph 4 90mm x 90mm timber post supporting roof truss.



Appendix B
Existing Drawings / Sketches

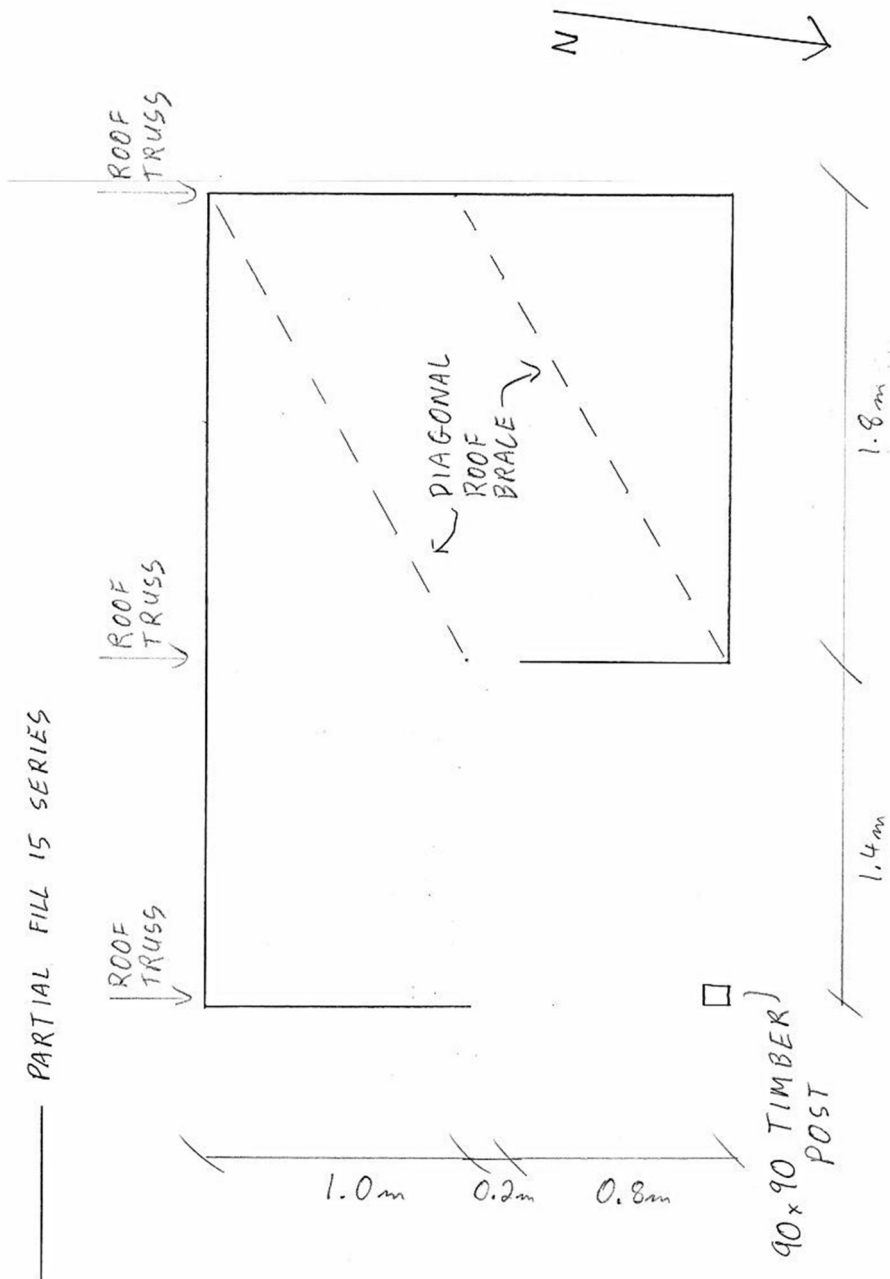



Appendix C
CERA Building Evaluation Form

Detailed Engineering Evaluation Summary Data

V1.11

Location		
Building Name:	Toilet Rawhiti Golf Course 6th Fairway	
Building Address:	Unit No: Street	35-37 Bowhill Road
Legal Description:	Pt Res 1616 (SO 2573, DP 3236)	
GPS south:	Degrees	Min Sec
	43	29 50.99
GPS east:	172	43 29.12
Building Unique Identifier (CCC):	PRK 2004 BLDG 016	
Reviewer:	Stephen Lee	
CPEng No:	1006840	
Company:	GHD	
Company project number:	513090230	
Company phone number:	04 472 0799	
Date of submission:	17/05/2013	
Inspection Date:	18-Jun-12	
Revision:	Final	
Is there a full report with this summary?	yes	

Site		
Site slope:	flat	
Soil type:	silty sand	
Site Class (to NZS1170.5):	D	
Proximity to waterway (m, if <100m):		
Proximity to clifftop (m, if < 100m):		
Proximity to cliff base (m,if <100m):		
Max retaining height (m):		
Soil Profile (if available):		
If Ground improvement on site, describe:		
Approx site elevation (m):	3.00	

Building		
No. of storeys above ground:	1	single storey = 1
Ground floor split?	no	
Storeys below ground:	0	
Foundation type:	raft slab	
Building height (m):	3.60	if Foundation type is other, describe:
Floor footprint area (approx):	6	height from ground to level of uppermost seismic mass (for IEP only) (m):
Age of Building (years):	30	3.6
		Date of design:
		1976-1992
Strengthening present?	no	If so, when (year)?
Use (ground floor):	public	And what load level (%g)?
Use (upper floors):		
Use notes (if required):	Toilet	Brief strengthening description:
Importance level (to NZS1170.5):	IL2	

Gravity Structure		
Gravity System:	load bearing walls	
Roof:	timber truss	truss depth, purlin type and cladding
Floors:	other (note)	describe system
Beams:		Corrugate steel on timber purlins
Columns:	timber	Raft slab
Walls:	partially filled concrete masonry	typical dimensions (mm x mm)
		90 x 90
		thickness (mm)
		140

Lateral load resisting structure		
Lateral system along:	partially filled CMU	Note: Define along and across in detailed report!
Ductility assumed, μ :	1.25	note total length of wall at ground (m):

Period along:	0.40	##### enter height above at H31	estimate or calculation?	
Total deflection (ULS) (mm):			estimate or calculation?	
maximum interstorey deflection (ULS) (mm):			estimate or calculation?	
Lateral system across:	partially filled CMU			
Ductility assumed, μ :	1.25			
Period across:	0.40	##### enter height above at H31	note total length of wall at ground (m):	
Total deflection (ULS) (mm):			estimate or calculation?	
maximum interstorey deflection (ULS) (mm):			estimate or calculation?	

Separations:

north (mm):		leave blank if not relevant
east (mm):		
south (mm):		
west (mm):		

Non-structural elements

Stairs:		
Wall cladding:		
Roof Cladding:		
Glazing:		
Ceilings:		
Services(list):		

Available documentation

Architectural	none	original designer name/date	
Structural	none	original designer name/date	
Mechanical	none	original designer name/date	
Electrical	none	original designer name/date	
Geotech report	none	original designer name/date	

Damage

Site: (refer DEE Table 4-2)

Site performance:		Describe damage:	
Settlement:	none observed	notes (if applicable):	
Differential settlement:	none observed	notes (if applicable):	
Liquefaction:	none apparent	notes (if applicable):	
Lateral Spread:	none apparent	notes (if applicable):	
Differential lateral spread:	none apparent	notes (if applicable):	
Ground cracks:	none apparent	notes (if applicable):	
Damage to area:	none apparent	notes (if applicable):	

Building:

Current Placard Status:

Along	Damage ratio:	0%	Describe how damage ratio arrived at: <input type="text"/>
	Describe (summary):		
Across	Damage ratio:	0%	
	Describe (summary):		

$$Damage_Ratio = \frac{(\% NBS (before) - \% NBS (after))}{\% NBS (before)}$$

Diaphragms	Damage?:	<input type="text" value="no"/>	Describe:	<input type="text"/>
CSWs:	Damage?:	<input type="text" value="no"/>	Describe:	<input type="text"/>
Pounding:	Damage?:	<input type="text" value="no"/>	Describe:	<input type="text"/>
Non-structural:	Damage?:	<input type="text" value="no"/>	Describe:	<input type="text"/>

Recommendations

Level of repair/strengthening required:	<input type="text" value="none"/>	Describe:	<input type="text"/>
Building Consent required:	<input type="text" value="no"/>	Describe:	<input type="text"/>
Interim occupancy recommendations:	<input type="text" value="full occupancy"/>	Describe:	<input type="text"/>

Along	Assessed %NBS before e'quakes:	<input type="text" value="59%"/>	59% %NBS from IEP below	If IEP not used, please detail assessment methodology:	<input type="text"/>
	Assessed %NBS after e'quakes:	<input type="text" value="59%"/>			
Across	Assessed %NBS before e'quakes:	<input type="text" value="59%"/>	59% %NBS from IEP below		
	Assessed %NBS after e'quakes:	<input type="text" value="59%"/>			

IEP **Use of this method is not mandatory - more detailed analysis may give a different answer, which would take precedence. Do not fill in fields if not using IEP.**

Period of design of building (from above): 1976-1992 h_n from above: 3.6m

Seismic Zone, if designed between 1965 and 1992: not required for this age of building
not required for this age of building

	along	across
Period (from above):	<input type="text" value="0.4"/>	<input type="text" value="0.4"/>
(%NBS) _{nom} from Fig 3.3:	<input type="text" value="16.5%"/>	<input type="text" value="16.5%"/>

Note:1 for specifically design public buildings, to the code of the day: pre-1965 = 1.25; 1965-1976, Zone A = 1.33; 1965-1976, Zone B = 1.2; all else 1.0
Note 2: for RC buildings designed between 1976-1984, use 1.2
Note 3: for buildings designed prior to 1935 use 0.8, except in Wellington (1.0)

	along	across
Final (%NBS)_{nom}:	<input type="text" value="17%"/>	<input type="text" value="17%"/>

2.2 Near Fault Scaling Factor Near Fault scaling factor, from NZS1170.5, cl 3.1.6:

	along	across
Near Fault scaling factor (1/N(T,D), Factor A:	<input type="text" value="1"/>	<input type="text" value="1"/>

2.3 Hazard Scaling Factor Hazard factor Z for site from AS1170.5, Table 3.3:
 Z_{1992} , from NZS4203:1992
Hazard scaling factor, **Factor B:**

2.4 Return Period Scaling Factor Building Importance level (from above):
Return Period Scaling factor from Table 3.1, **Factor C:**

2.5 Ductility Scaling Factor

Assessed ductility (less than max in Table 3.2)	along	1.25	across	1.25
Ductility scaling factor: =1 from 1976 onwards; or = κ , if pre-1976, from Table 3.3:		1.00		1.00
Ductility Scaling Factor, Factor D:		1.00		1.00

2.6 Structural Performance Scaling Factor:

Sp:	0.925	0.925
Structural Performance Scaling Factor Factor E:	1.081081081	1.081081081

2.7 Baseline %NBS, (NBS%)_b = (%NBS)_{nom} x A x B x C x D x E

%NBS _b :	59%	59%
---------------------	-----	-----

Global Critical Structural Weaknesses: (refer to NZSEE IEP Table 3.4)

3.1. Plan Irregularity, factor A: insignificant 1

3.2. Vertical irregularity, Factor B: insignificant 1

3.3. Short columns, Factor C: insignificant 1

3.4. Pounding potential
 Pounding effect D1, from Table to right 1.0
 Height Difference effect D2, from Table to right 1.0

Therefore, Factor D: 1

3.5. Site Characteristics insignificant 1

Table for selection of D1	Severe	Significant	Insignificant/none
	0<sep<.005H	.005<sep<.01H	Sep>.01H
Separation			
Alignment of floors within 20% of H	0.7	0.8	1
Alignment of floors not within 20% of H	0.4	0.7	0.8

Table for Selection of D2	Severe	Significant	Insignificant/none
	0<sep<.005H	.005<sep<.01H	Sep>.01H
Separation			
Height difference > 4 storeys	0.4	0.7	1
Height difference 2 to 4 storeys	0.7	0.9	1
Height difference < 2 storeys	1	1	1

3.6. Other factors, Factor F

For ≤ 3 storeys, max value =2.5, otherwise max value =1.5, no minimum	Along	1.0	Across	1.0
Rationale for choice of F factor, if not 1		1		1

Detail Critical Structural Weaknesses: (refer to DEE Procedure section 6)

List any: Refer also section 6.3.1 of DEE for discussion of F factor modification for other critical structural weaknesses

3.7. Overall Performance Achievement ratio (PAR)

1.00	1.00
------	------

4.3 PAR x (%NBS)_b:

PAR x Baseline %NBS:	59%	59%
----------------------	-----	-----

4.4 Percentage New Building Standard (%NBS), (before)

59%

Official Use only:

Accepted By: _____
 Date: _____



GHD

GHD Building
226 Antigua Street, Christchurch 8013
T: 64 3 378 0900 F: 64 3 377 8575 E: chcmail@ghd.com

© GHD Limited 2013

This document is and shall remain the property of GHD Limited. The document may only be used for the purpose for which it was commissioned and in accordance with the Terms of Engagement for the commission. Unauthorised use of this document in any form whatsoever is prohibited.

Document Status

Rev No.	Author	Reviewer		Approved for Issue		
		Name	Signature	Name	Signature	Date
Final	Paul Clarke	Alex Baylis		Stephen Lee		17/05/13