

Flow data

The table shows the quantity of wastewater treated each day during the last month.

Date	Flow (m ³ /day)	Consent limit (m ³ /day)
1/04/2019	144	600
2/04/2019	158	600
3/04/2019	144	600
4/04/2019	135	600
5/04/2019	187	600
6/04/2019	156	600
7/04/2019	154	600
8/04/2019	145	600
9/04/2019	139	600
10/04/2019	136	600
11/04/2019	132	600
12/04/2019	139	600
13/04/2019	153	600
14/04/2019	154	600
15/04/2019	130	600
16/04/2019	155	600
17/04/2019	133	600
18/04/2019	134	600
19/04/2019	145	600
20/04/2019	128	600
21/04/2019	129	600
22/04/2019	138	600
23/04/2019	136	600
24/04/2019	127	600
25/04/2019	138	600
26/04/2019	129	600
27/04/2019	135	600
28/04/2019	147	600
29/04/2019	200	600
30/04/2019	164	600

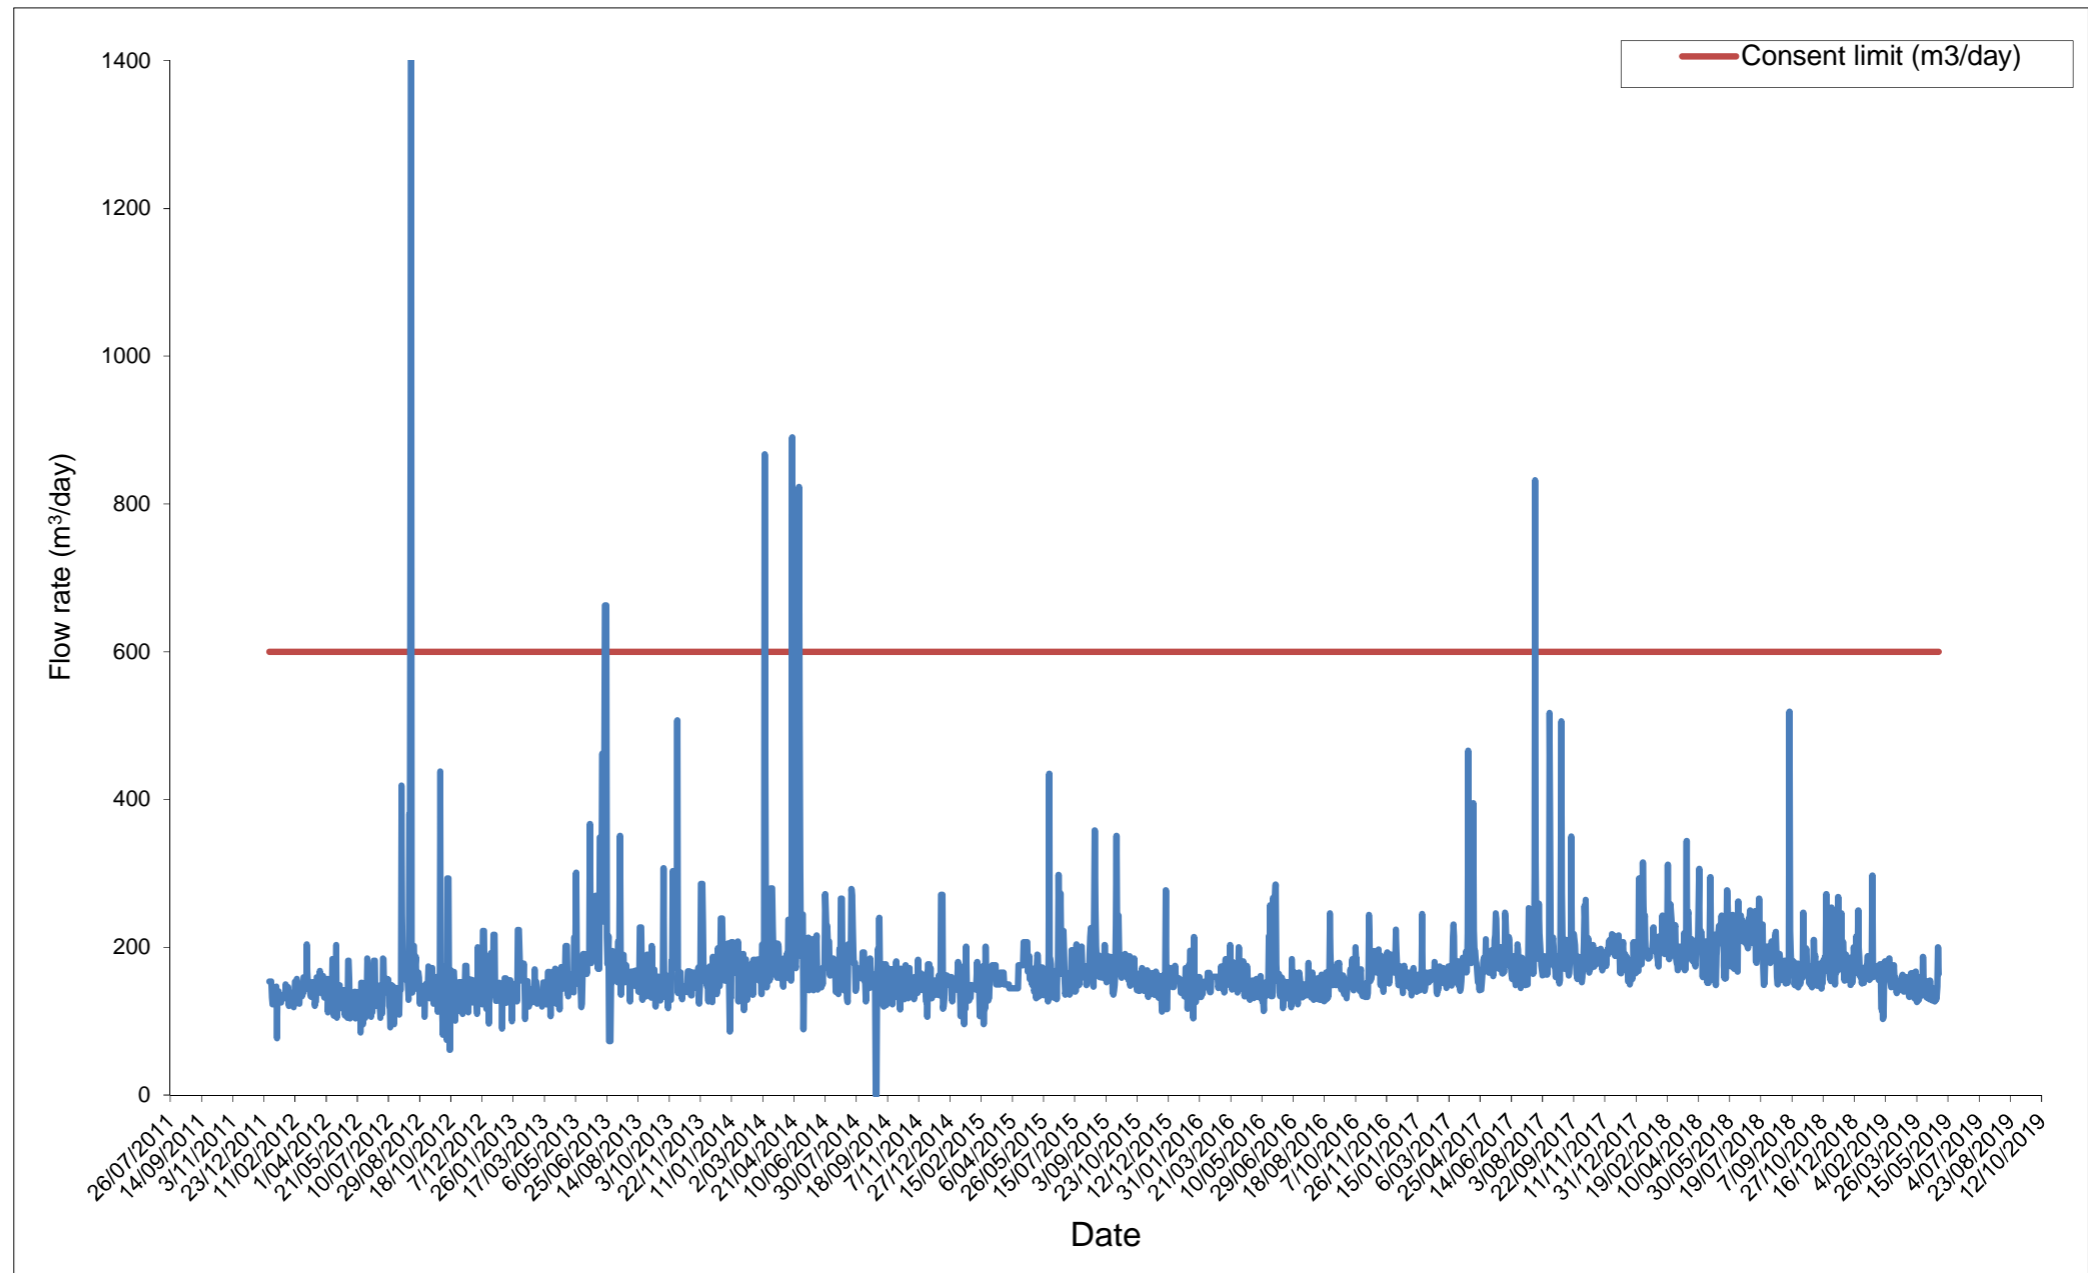


Figure 1: The daily quantity of treated water from the Governors Bay wastewater treatment plant 2012 to present

Legend
m³ cubic metres