

Flow data

The table shows the quantity of wastewater treated each day during the last month. Figure 1 shows the daily quantity of wastewater treated back to 2011.

Date	Flow (m ³ /day)	Consent limit (m ³ /day)
28/02/2021	341	2500
1/03/2021	293	2500
2/03/2021	300	2500
3/03/2021	286	2500
4/03/2021	297	2500
5/03/2021	292	2500
6/03/2021	342	2500
7/03/2021	339	2500
8/03/2021	297	2500
9/03/2021	281	2500
10/03/2021	273	2500
11/03/2021	297	2500
12/03/2021	284	2500
13/03/2021	325	2500
14/03/2021	328	2500
15/03/2021	283	2500
16/03/2021	195	2500
17/03/2021	185	2500
18/03/2021	271	2500
19/03/2021	266	2500
20/03/2021	275	2500
21/03/2021	303	2500
22/03/2021	238	2500
23/03/2021	235	2500
24/03/2021	231	2500
25/03/2021	234	2500
26/03/2021	241	2500
27/03/2021	287	2500
28/03/2021	287	2500
29/03/2021	246	2500
30/03/2021	226	2500
31/03/2021	222	2500

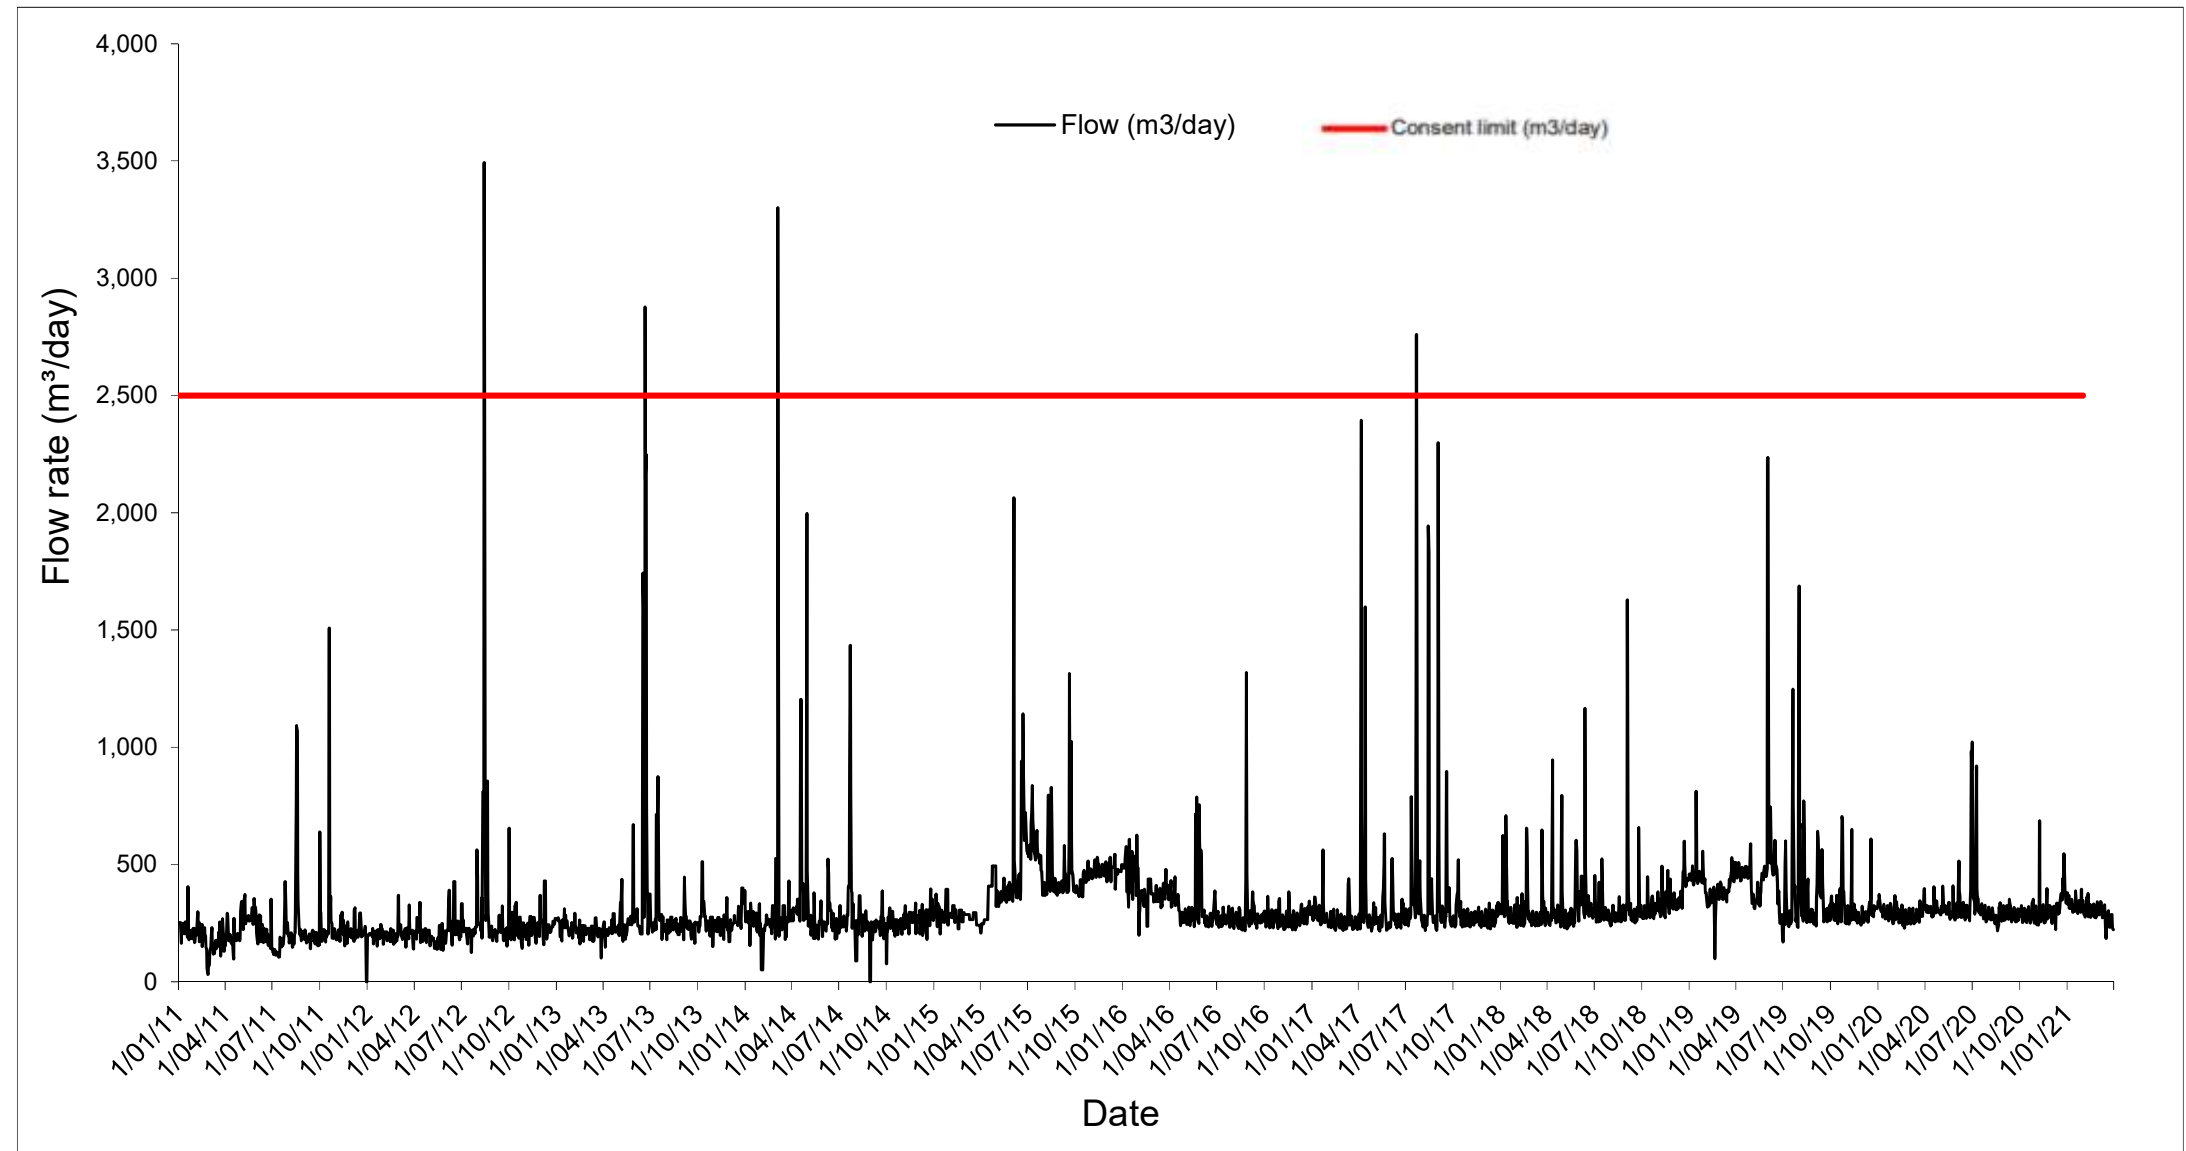


Figure 1: The daily quantity of treated water from 2012 to present at Diamond Harbour wastewater treatment plant.

Legend: m³ cubic metres

