

## Flow data

The table shows the quantity of wastewater treated each day during the last month. Figure 1 shows the daily quantity of wastewater treated back to 2011.

Date	Flow (m <sup>3</sup> /day)	Consent limit (m <sup>3</sup> /day)
1/09/2021	273	2500
2/09/2021	268	2500
3/09/2021	279	2500
4/09/2021	316	2500
5/09/2021	291	2500
6/09/2021	288	2500
7/09/2021	269	2500
8/09/2021	299	2500
9/09/2021	260	2500
10/09/2021	249	2500
11/09/2021	316	2500
12/09/2021	304	2500
13/09/2021	344	2500
14/09/2021	344	2500
15/09/2021	282	2500
16/09/2021	253	2500
17/09/2021	258	2500
18/09/2021	271	2500
19/09/2021	314	2500
20/09/2021	261	2500
21/09/2021	253	2500
22/09/2021	250	2500
23/09/2021	243	2500
24/09/2021	257	2500
25/09/2021	288	2500
26/09/2021	275	2500
27/09/2021	238	2500
28/09/2021	251	2500
29/09/2021	237	2500
30/09/2021	240	2500

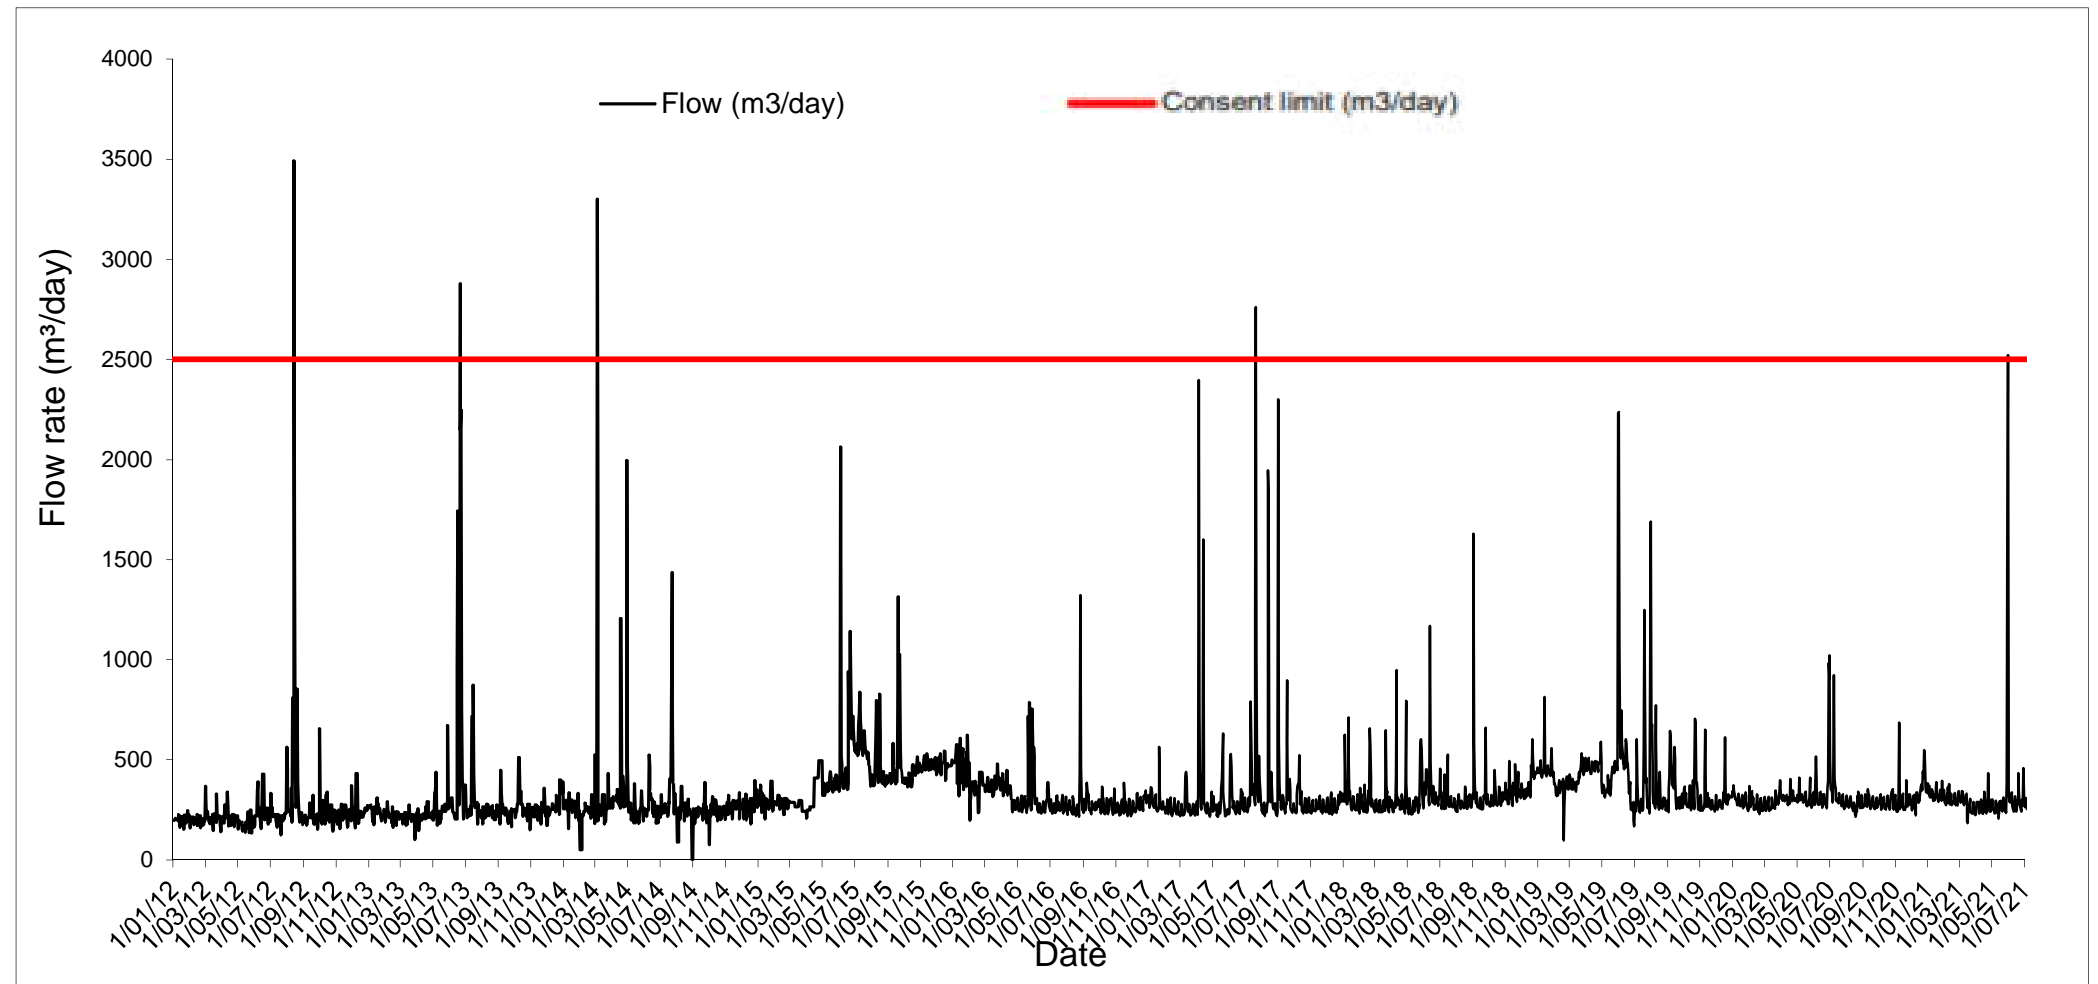


Figure 1: The daily quantity of treated water from 2012 to present at Diamond Harbour wastewater treatment plant.

Legend  
m<sup>3</sup> cubic metres