

### Flow data

Date	Flow (m3/day)	Consent limit (m3/day)
1/06/2021	1399.1	1500
2/06/2021	635.6	1500
3/06/2021	475.4	1500
4/06/2021	446.0	1500
5/06/2021	537.8	1500
6/06/2021	542.1	1500
7/06/2021	512.7	1500
8/06/2021	323.8	1500
9/06/2021	333.8	1500
10/06/2021	334.7	1500
11/06/2021	337.8	1500
12/06/2021	393.2	1500
13/06/2021	443.0	1500
14/06/2021	352.0	1500
15/06/2021	347.1	1500
16/06/2021	314.4	1500
17/06/2021	427.5	1500
18/06/2021	456.8	1500
19/06/2021	420.2	1500
20/06/2021	1725.0	1500
21/06/2021	1712.3	1500
22/06/2021	876.4	1500
23/06/2021	634.2	1500
24/06/2021	570.4	1500
25/06/2021	545.2	1500
26/06/2021	569.0	1500
27/06/2021	565.3	1500
28/06/2021	552.4	1500
29/06/2021	915.4	1500
30/06/2021	725.0	1500

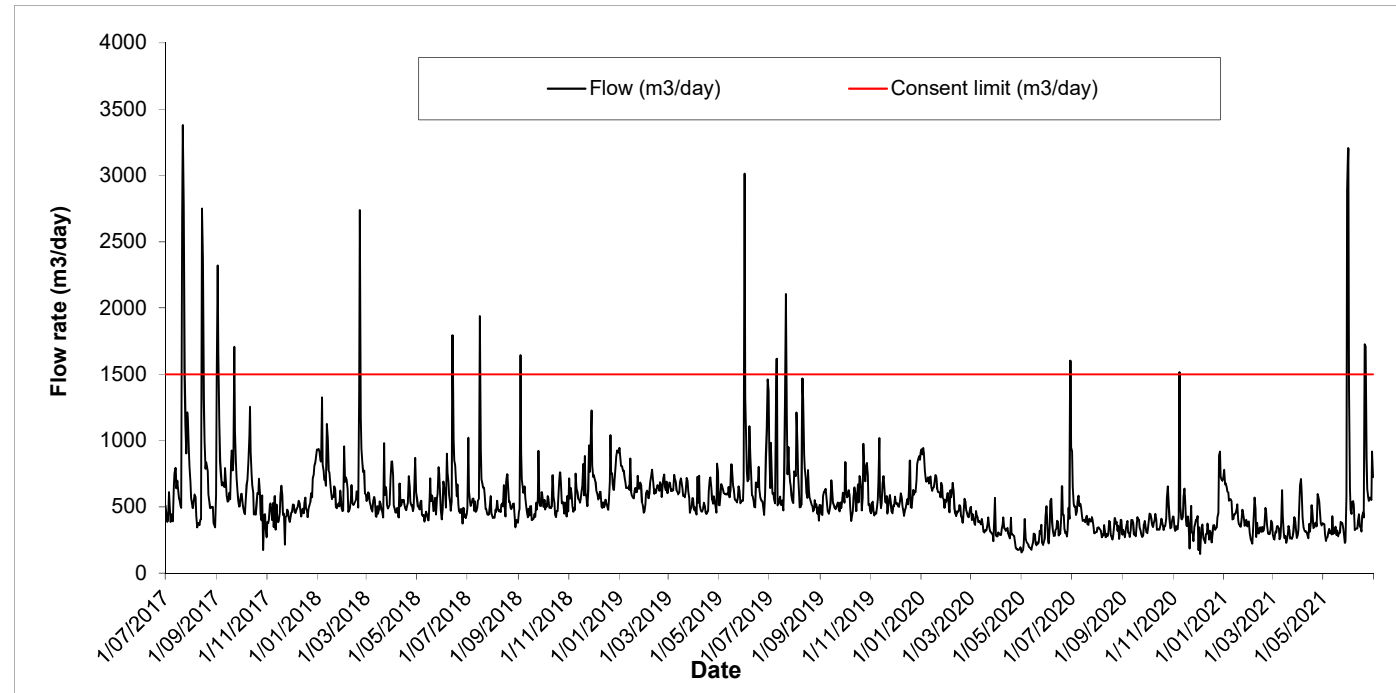


Figure 1: The daily quantity of treated water from 2017 to present at Akaroa wastewater treatment plant.

Legend m<sup>3</sup> cubic metres

Ave. flowrate in Period:	7.33 l/s
Max. flowrate in period :	40.58 l/s